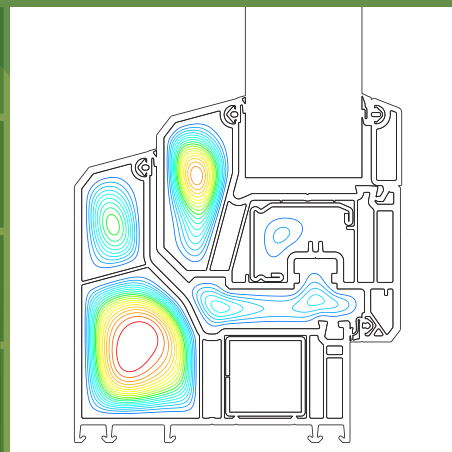
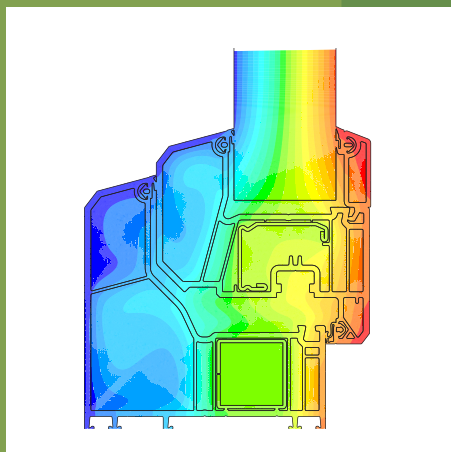


ARILD GUSTAVSEN, BJØRN PETTER JELLE,
DARIUSH ARASTEH (LBNL) AND CHRISTIAN KOHLER (LBNL)

State-of-the-Art Highly Insulating Window Frames – Research and Market Review

Project report 6

2007



SINTEF Building and Infrastructure

**State-of-the-Art
Highly Insulating Window Frames –
Research and Market Review**

Project report 6 – 2007

Project report no 6

Arild Gustavsen^{1) 2)}, Bjørn Petter Jelle^{1) 3)}, Dariush Arasteh⁴⁾ and Christian Kohler⁴⁾

State-of-the-Art

Highly Insulating Window Frames – Research and Market Review

Keywords:

Windows, window frame, energy use, thermal transmittance, U-value, Passivhaus

Figures on coverpage are based on work reported in Gustavsen et al. (2007)

ISSN 1504-6958

ISBN 978-82-536-0970-6

25 copies printed by AIT AS e-dit

Content: 100 g scandia

Cover: 240 g trucard

© Copyright SINTEF Building and Infrastructure 2007

The material in this publication is covered by the provisions of the Norwegian Copyright Act. Without any special agreement with SINTEF Building and Infrastructure, any copying and making available of the material is only allowed to the extent that this is permitted by law or allowed through an agreement with Kopinor, the Reproduction Rights Organisation for Norway. Any use contrary to legislation or an agreement may lead to a liability for damages and confiscation, and may be punished by fines or imprisonment.

Address: Forskningsveien 3 B
 POBox 124 Blindern
 N-0314 OSLO

Tel: +47 22 96 55 55

Fax: +47 22 69 94 38 og 22 96 55 08

www.sintef.no/byggforsk

- 1) SINTEF Building and Infrastructure, Forskningsveien 3 b, P.O.Box 124 Blindern, NO-0314 Oslo/Høgskoleringen 7B, NO-7465 Trondheim.
- 2) Department of Architectural Design, History and Technology, Norwegian University of Science and Technology (NTNU), Alfred Getz vei 3, NO-7491 Trondheim.
- 3) Department of Civil and Transport Engineering, Norwegian University of Science and Technology (NTNU), Høgskoleringen 7A, NO-7491 Trondheim.
- 4) Windows and Daylighting Group, Lawrence Berkeley National Laboratory, 1 Cyclotron Road Mail Stop 90R3111, Berkeley, CA 94720-8134.

Acknowledgement

This work is supported by the Assistant Secretary of Energy Efficiency and Renewable Energy, Office of Building Technology, U.S. Department of Energy under Contract No. DE-AC02-05CH11231 and by the Research Council of Norway within the research project MOT – «Modern Wood Window Frames with Surface Treatment» (In Norwegian: Moderne trevindu med overflatebehandling).

Summary

This document reports the findings of a market and research review related to state-of-the-art highly insulating window frames. The market review focuses on window frames that satisfy the Passivhaus requirements (window U-value less or equal to $0.8 \text{ W/m}^2\text{K}$), while other examples are also given in order to show the variety of materials and solutions that may be used for constructing window frames with a low thermal transmittance (U-value). The market search shows that several combinations of materials are used in order to obtain window frames with a low U-value. The most common insulating material seems to be Polyurethane (PUR), which is used together with most of the common structural materials such as wood, aluminum, and PVC.

The frame research review also shows examples of window frames developed in order to increase the energy efficiency of the frames and the glazings which the frames are to be used together with. The authors find that two main tracks are used in searching for better solutions. The first one is to minimize the heat losses through the frame itself. The result is that conductive materials are replaced by highly thermal insulating materials and air cavities. The other option is to reduce the window frame area to a minimum, which is done by focusing on the net energy gain by the entire window (frame, spacer and glazing). Literature shows that a window with a higher U-value may give a net energy gain to a building that is higher than a window with a smaller U-value. The net energy gain is calculated by subtracting the transmission losses through the window from the solar energy passing through the windows. The net energy gain depends on frame versus glazing area, solar factor, solar irradiance, calculation period and U-value.

The frame research review also discusses heat transfer modeling issues related to window frames. Thermal performance increasing measures, surface modeling, and frame cavity modeling are among the topics discussed. The review shows that the current knowledge gives the basis for improving the calculation procedures in the calculation standards. At the same time it is room for improvement within some areas, e.g. to fully understand the natural convection effects inside irregular vertical frame cavities (jambs) and ventilated frame cavities.

Contents

1	Introduction.....	6
1.1	Background.....	6
1.2	Report Outline.....	7
2	Thermal Performance Rating.....	8
2.1	Thermal Transmittance (U-value).....	8
2.2	Energy Gain.....	10
2.3	Classification Schemes.....	11
3	What Makes a Window?	13
3.1	Window.....	13
3.2	Window Glazing.....	14
3.3	Window Frame Types.....	16
4	Window Frames Research.....	17
4.1	Effect of Frame and Spacer on Window U-Value.....	17
4.2	Thermal Performance Improving Measures.....	17
4.3	3D and Other Effects on Thermal Performance.....	22
4.4	Heat Transfer Modeling of Window Frame Cavities.....	22
4.5	Exterior and Interior Surface Modeling.....	30
4.6	Spacer Research.....	32
4.7	Evaluation of Condensation Risk.....	33
4.8	Other Topics (Material Properties, etc).....	33
5	Market Review of Window Frames.....	35
5.1	Various Window Frame Examples.....	35
5.1.1	Wood Frame.....	36
5.1.2	Wood Frame with Insulation Filled Al Cladding.....	38
5.1.3	PVC Frame.....	39
5.1.4	PVC Frame with Insulation Filled Al Cladding.....	40
5.1.5	Al Frame.....	40
5.1.6	Fixed Wood and Al Frame.....	41
5.1.7	Glass Facade System.....	42
5.1.8	Window Frame Examples with Higher U-Values than the Passivhaus Requirement.....	43
5.2	U-Value Comparison for Various Window Frame Types.....	44
5.3	Materials Applied in Window Frames.....	44

5.4	Spacers	47
5.4.1	Spacers in General	47
5.4.2	Swisspacer	48
5.4.3	Thermix	49
6	Discussion.....	52
6.1	Frame Thermal Performance Rating	52
6.2	Heat Transfer Modeling	53
6.3	Frame Materials and Design	54
6.4	Window Frame Research and Development Aims	56
7	Conclusions	58
8	References	59
	Appendix – List of Highly Thermal Insulating Window Frames.....	A-1

1 Introduction

1.1 Background

In northern climates the construction of well-insulated buildings is important for reducing the energy use for heating, especially in small residential buildings. Even in larger commercial buildings where internal gains may exceed the transmission losses, well-insulated buildings are desirable. This is because well-insulated buildings have less transmission losses and because thermal discomfort due to badly insulated constructions can be avoided. Because of this, focus has been put on the insulating capabilities of building sections for years. In Norway, for instance, the requirements for the thermal transmittance (U-value) of new building sections like roofs, external walls and windows were last restricted in 2007 (NBC 2007). Table 1 shows the U-value requirements and also the evolution of the U-value requirements for different building sections according to the Norwegian building code. From 1969 to 2007 the thermal transmittance requirements of new outer walls were reduced from 0.46 W/m²K to 0.18 W/m²K. For windows the reduction has been from 3.14 to 1.2 W/m²K. Even though there have been a reduction for all building envelope parts it is evident that the U-value requirement for windows and doors is very different that the requirements for the other envelope parts. The reason for this is of course that windows are built from other materials than the opaque materials used in typical roofs, walls and floors.

Because of the large difference in U-value between windows and other building constructions, the energy losses through windows will contribute to a large part of the transmission losses for a building. For a two-story residential house with base area of $8 \times 10 \text{ m}^2$, height of $2 \times 2.5 \text{ m}$ and with 30 % of the walls covered by windows about 60 % of the total energy loss through the building envelope of that building will be through the windows, if the building envelope sections of the building comply with the U-value requirements of NBC (2007). If the window area is reduced to 20 % the corresponding percentage is about 45 %. Thus, decreasing the U-value of windows can be an important factor in reducing the energy use for heating in residential buildings. However, it should not be forgotten that windows also allows for solar energy to enter the building.

The window frame is an important part of a fenestration product. Looking at a window with a total area of $1.2 \times 1.2 \text{ m}^2$ and a frame with a width of 10 cm, the area occupied by the frame is 30 % of the total. If the total area of the window is increased to $2.0 \times 2.0 \text{ m}^2$ the percentage is 19 % (still using the same frame). That is, a substantial part of the heat loss will be attributed to the frame, especially if the frame has an U-value that is higher than the glazing U-value.

In rating fenestration products engineers area weight the thermal performance of the different parts to find one number describing the entire product. Thus, to get a window with a low U-value, both the glazing and the frame need to have a low thermal transmittance (in addition to the edge part of the window). Below, typical glazing and frame types will be presented as an introduction to the window frame research and market state-of-the-art.

Table 1. Thermal transmittance (W/m^2K) requirements according to Norwegian building codes^{a)}.

Building Sections	Norwegian building code 1969 (NBC 1969)	Norwegian building code 1987 (NBC 1987)	Norwegian building code 1997 (NBC 1997)	Norwegian building code 2007 (NBC 2007)
Temperature		> 18 °C	≥ 20 °C	
Outer Wall	0.46	0.3	0.22	0.18
Window	3.14	2.4	1.6	1.2
Door	3.14	2.0	1.6	1.2
Roof	0.41	0.2	0.15	0.13
Floor	0.46	0.3	0.15	0.15

^{a)} This table simplifies the U-value requirements for some building sections and building codes. Please refer to the different building codes for detailed information.

1.2 Report Outline

The focus in this report lies on window frames with a high thermal performance; that is on frames with a significantly lower U-value than traditional frames, and frames for which special actions have been taken to reduce the heat loss or in other regards increase the thermal performance. Because the thermal transmittance of window frames is coupled to the glazing spacer (according to some calculation procedures), information related to typical glazing spacers is also included. The main part of the work in this report relates to the research review (Chapter 4) and the market review presented in Chapter 5. The following division in chapters is selected:

- Chapter 1 gives a short background for this report.
- Chapter 2 explains typical thermal performance rating procedure for windows and window frames.
- Chapter 3 explains the typical parts that a window is made of, and typical ways of classification.
- Chapter 4 presents frame related research found in scientific journals and reports. Modeling issues has got the most attention, but new frame designs are also presented.
- Chapter 5 presents the most interesting results from the market review. A separate list is given in the Appendix.
- In Chapter 6 the findings of the previous two chapters are summarized and discussed.
- Chapter 7 concludes the report.

2 Thermal Performance Rating

The most common way of rating fenestration products is by the U-value and the g-value (solar factor). The U-value is the thermal transmittance and the g-value is the total solar energy transmittance (denoted with a number between 0 and 1). In addition the air leakage will have an influence on the energy performance of the various products. The visible transmittance and condensation resistance are also important factors that may be noted. All these parameters can be found by performing measurements or simulations according to documents published by ISO, CEN and NFRC. These documents will not be further described here. Instead issues related to various window and frame U-value calculation procedures and other rating procedures, important for understanding some of the topics in later chapters, will be described.

2.1 Thermal Transmittance (U-value)

First, the authors note that people should be aware of two different ways of calculating the thermal transmittance (U-value) of windows and window frames, in particular. These are often referred to as the ASHRAE procedure (based on ASHRAE SPC 142P) and the ISO procedures (described in ISO 10077-2). (The two procedures are also described in ISO 15099.) The two approaches are different in the way they treat the effect of the glazing spacer on the heat transfer through the frame and the glazing unit near the frame. The ASHRAE method assumes that the spacer influences both the heat transfer through the frame and the heat transfer through the glazing in an ‘‘edge-of glass’’ region. The edge-of-glass region is set equal to a 63.5 mm (2.5 inch) wide area, measured from the glazing/frame sight line. To find the frame and edge-of-glass thermal transmittances the frame is simulated with the glazing/spacer inserted. The total window U-value is calculated according to

$$U_{w,ASHRAE} = \frac{U_{cg}A_c + \sum U_{fr}A_f + \sum U_{eg}A_e}{A_t} \quad (1)$$

where U_{cg} is the center-of-glass U-value and where A_c , A_f , A_e and A_t denote the center-of-glass area, the frame area, the edge-of-glass area, and the total window area, respectively. U_{fr} and U_{eg} are determined from the following equations:

$$U_{fr} = \frac{\Phi_{fr}}{l_f (T_{ni} - T_{ne})} \quad (2)$$

$$U_{eg} = \frac{\Phi_{eg}}{l_{eg} (T_{ni} - T_{ne})} \quad (3)$$

where l_f is the projected length of frame area and l_{eg} is the length of the edge-of-glass area, which is equal to 63.5 mm. These lengths are measured on the internal side. Φ_{fr} and Φ_{eg} are heat flow rates through frame and edge-glass areas (internal surfaces), respectively, including the effect of glass and spacer. Both Φ_{fr} and Φ_{eg} are expressed per length of frame or edge-glass areas. The summations in Eq. (1) are used to account for the various sections of one particular component type; e.g. several values of the projected frame area, A_f , are needed in order to sum the contributions of different values of U_{fr} corresponding to sill, head and side jambs. T_{ni} and T_{ne} denote the interior and exterior temperature, respectively.

To follow the ISO method the frame has to be simulated both with an insulation panel and with the glazing/spacer. A linear thermal transmittance that depends on the spacer/glazing configuration can then be calculated. The additional heat transfer due to the existence of the spacer is then assumed to be proportional to the glazing/frame sightline distance that is also proportional to the total glazing spacer length. Thus, the total window U-value is calculated according to

$$U_{w,ISO} = \frac{U_g A_g + \sum U_f A_f + \sum l_\Psi \Psi}{A_t} \quad (4)$$

where U_g is the center-of-glass U-value and where A_g and A_f denote projected vision and frame area. A_t is the total window area. To find the frame U-value the frame is simulated with an insulation panel instead of the real glazing and spacer. Ψ and U_f are then determined from the following equations:

$$\Psi = L^{2D} - U_f l_f - U_g l_g \quad (5)$$

$$U_f = \frac{L_p^{2D} - U_p l_p}{l_f} \quad (6)$$

L^{2D} is the thermal coupling coefficient determined from the actual fenestration system (frame, glazing and spacer) and L_p^{2D} is the coupling coefficient determined from the frame/panel insert system. Further, U_p is the thermal transmittance of the foam insert, l_p is the internal side exposed length of foam insert, l_f is the internal side projected length for frame section, and l_g is the internal side projected length of the glass section.

Note that the two ways of calculating the frame U-value in Eq. (2) and Eq. (6) give different frame U-values. The reason for this difference is that one of the U-values is found by simulating the frame with the actual glazing system, while in the other method the frame is simulated with an insulation panel. The frame U-values presented in this report are based on Eq. (6), that is ISO 10077-2.

Blanusa et al. (2007) compare the ISO and ASHRAE procedures and find that the two procedures give U-values that differ both for the frame and the entire window product. The difference is largest for small windows. A maximum difference of 3 % is found for entire windows. The difference was explained by the way the corner regions of the window frame and glazing are treated by the assembly of the overall thermal transmittance for a three-dimensional window from the two-dimensional calculations. It is therefore important, if products are compared, that the procedures used to find the U-value are noted.

2.2 Energy Gain

Nielsen et al. (2000) introduces a method to rate and select windows for new buildings or buildings that are going to be retrofitted. The method considers *Net Energy Gain* for the windows in question; that is, a net energy gain is calculated by subtracting the transmission losses through the windows from the solar energy passing through the windows,

$$E = I \cdot g - U \cdot D \quad [\text{kWh/m}^2] \quad (7)$$

I (kWh/m²) is the solar gain during the heating season corrected for the g-value's dependency on the incidence angle. D (kKh) is the degree hour during the heating season. The heating season is in this study set to 24/9–13/5. I and D are dependent on the climate and I also depends on the orientation of the windows. A negative net energy gain indicates that the heat loss is larger than the solar gain. Nielsen et al. (2000) only consider the net energy gain for the windows, and not other losses and gains. The net energy gain calculations are based on the temperature and solar radiation conditions of a Design Reference Year (hourly values), and in their study $D = 90.36$ kKh. Using this method it is possible to produce diagrams that show the net energy gain as a function of the U-value, g-value, orientation, and tilt of the glazing or windows, see Figure 1. The method can take into account shading and utilization degree of the heat transmitted into the building. The authors note that the method should only be used in heating dominated buildings. The method is further elaborated on in Lautsen and Svendsen (2005) and Svendsen et al. (2005).

It is noted that similar methods also have been suggested by others, e.g. for rating fenestration products in Canada. There, thermal transmittance losses (using the U-value), solar heat gain and air infiltration losses are counted for. Arasteh et al. (2007) also presents similar plots as Nielsen et al. (2000), and use these to define the performance criteria for residential Zero Energy Windows. Through the use of *whole house energy modeling*, typical efficient products are evaluated in five US climates and compared against the requirements for Zero Energy Homes. The performance threshold at which a window provides net energy gain for the building rather than net energy loss is determined

by simulating the building in question with no heat flow through the windows, i.e., the g-value and U-value properties of the windows were set to zero, representing perfect thermal resistance, with no solar transmittance. Both cooling and heating is accounted for, with thermostat set points being 21.1 °C for heating and 25.6 °C for cooling.

There also exist software tools that are especially designed to evaluate the thermal performance of windows. An example is RESFEN (Mitchell et al. 2005), which calculates heating and cooling energy use and associated costs as well as peak heating and cooling demand for specific window products (<http://windows.lbl.gov/software/resfen/resfen.html>). Users define a specific "scenario" by specifying house type (single-story or two-story), geographic location, orientation, electricity and gas cost, and building configuration details (such as wall, floor, and HVAC system type). Users also specify size, shading, and thermal properties of the window they wish to investigate. The thermal properties that RESFEN requires are: U-value, solar heat gain coefficient, and air leakage rate. RESFEN calculates the energy and cost implications of the window compared to an insulated wall. The relative energy and cost impacts of two different windows can be compared.

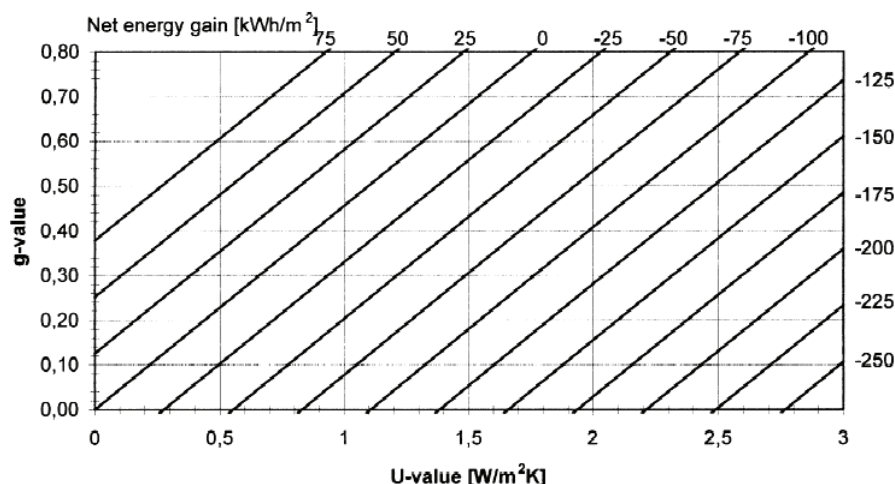


Figure 1. Example of net energy gain diagram for a one-family house in Danish climate during the period 24/9–13/5 (heating season). The net energy gain is determined taking into account the orientation of the windows in the building and a shading factor of $F = 0.7$ (Nielsen et al. 2000).

2.3 Classification Schemes

There exist several certification schemes that producers can try to fulfill in order to say that their product is energy efficient. One of the most strict one (in regard to requirements of a low U-value), is the one specified by the Passivhaus Institute in Germany (www.passiv.de). To fulfill the *Passivhaus* requirements (www.passiv.de) the following demands have to be reached for the glazing, window and frame:

- $U_g \leq 0.80 \text{ W/m}^2\text{K}$ (window glazing)
- $U_w \leq 0.80 \text{ W/m}^2\text{K}$ (window as a whole)
- U_f so that $U_w \leq 0.80 \text{ W/m}^2\text{K}$ (window frame)

If a glazing with a U_g -value equal to $0.80 \text{ W/m}^2\text{K}$ are to be used in a window where the U_w -value have to be $0.80 \text{ W/m}^2\text{K}$, the frame U-value must be smaller than $0.80 \text{ W/m}^2\text{K}$, because of the edge of glass region where the spacer is situated (see Eqs. 3 and 5). If for example the glazing has a U_g -value considerable below $0.80 \text{ W/m}^2\text{K}$ the frame U-value may be somewhat above $0.80 \text{ W/m}^2\text{K}$ and still be able to fulfill the window $U_w \leq 0.80 \text{ W/m}^2\text{K}$ requirement. The exact value has to be calculated for the different windows configurations.

The majority of the windows and frames reported below comply with the Passivhaus requirements. The standard ISO 10077-2 is used to calculate the frame U-value. That is, an insulation panel is used instead of the actual glazing, see also Chapter 2.1.

3 What Makes a Window?

3.1 Window

According to Wikipedia (2007) and Encyclopædia Britannica (2007) a window is an opening in an otherwise solid and opaque surface that allows the passage of light and air. Encyclopædia Britannica (2007) further notes that windows often are arranged for the purposes of architectural decoration. Since early times, the openings have been filled with stone, wooden, or iron grilles or lights (panes) of glass or other translucent material such as mica or, in the Far East, paper. Modern windows are almost always filled with glass, though a few use transparent plastic. A window in a vertically sliding frame is called a sash window: a single-hung sash has only one half that moves; in a double-hung sash, both parts slide. A casement window opens sideward on a hinge.

Within this report a *window* is defined as consisting of:

- Window glazing
 - Glass (single, double, triple, etc.)
 - Spacer (Al, Swisspacer, Thermix, etc.)
 - Cavity gas (air, argon, krypton, xenon)
 - Glass coating (low emissivity coatings, solar control coatings, etc.)
- Window frame
 - Various frame/casing structures, fixed/opening windows, etc.
 - Structural frame materials
 - Highly thermal insulating materials

Windows may be classified into various types, e.g. according to their operating system. One example is depicted in Figure 2. Figure 3 shows properties which have to be addressed in order to make a high-performance window with respect to thermal insulating properties.



Figure 2. Figures showing classification of windows according to their operating system. From <http://www.efficientwindows.org/otypes.cfm>.

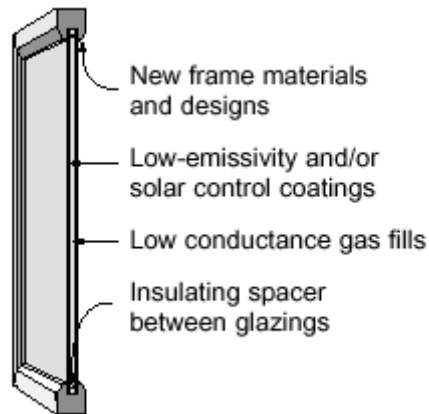


Figure 3. Properties making up a high-performance window (<http://www.buildcentral.com/windows/about.asp>).

The U-value of the window glazing have been decreased throughout the years, e.g. from 3.0 W/m²K to 1.6 W/m²K and further down to 1.2 W/m²K for double glazing. By applying triple glass panes and low emissivity coatings on two glasses, the U_g-value has been further decreased down to 0.7 W/m²K (argon filled cavities) and 0.5 W/m²K (krypton filled cavities). Window frame U-values above 1.0 W/m²K for traditional window frames are therefore becoming a minimum factor in the window design of today, which may hamper the goal of reduced heat loss through the windows. In order to reduce the heat loss from buildings in general and windows in particular, it is therefore crucial to develop highly thermal insulating window frames.

3.2 Window Glazing

The glazing is usually the larger part of a window. Various classification systems of glazing types or window glass panes may be found in the literature, where one example is shown in Figure 4.

Typical window glazing U-values depending on number of glasses, thickness of cavity, choice of cavity gas and number of low emissivity coatings are given in Table 2. Increasing number of glasses, increasing number of low emissivity coatings and application of argon or krypton instead of air, decreases the U_g-value substantially. The lowest U_g-value of 0.5 W/m²K is found for a glazing with three layers of glass, two low emissivity coatings and krypton in the cavities for a normal 4E-12-4-12-E4 configuration (E = low emissivity coating, each cavity 12 mm, 4 mm thick glasses).

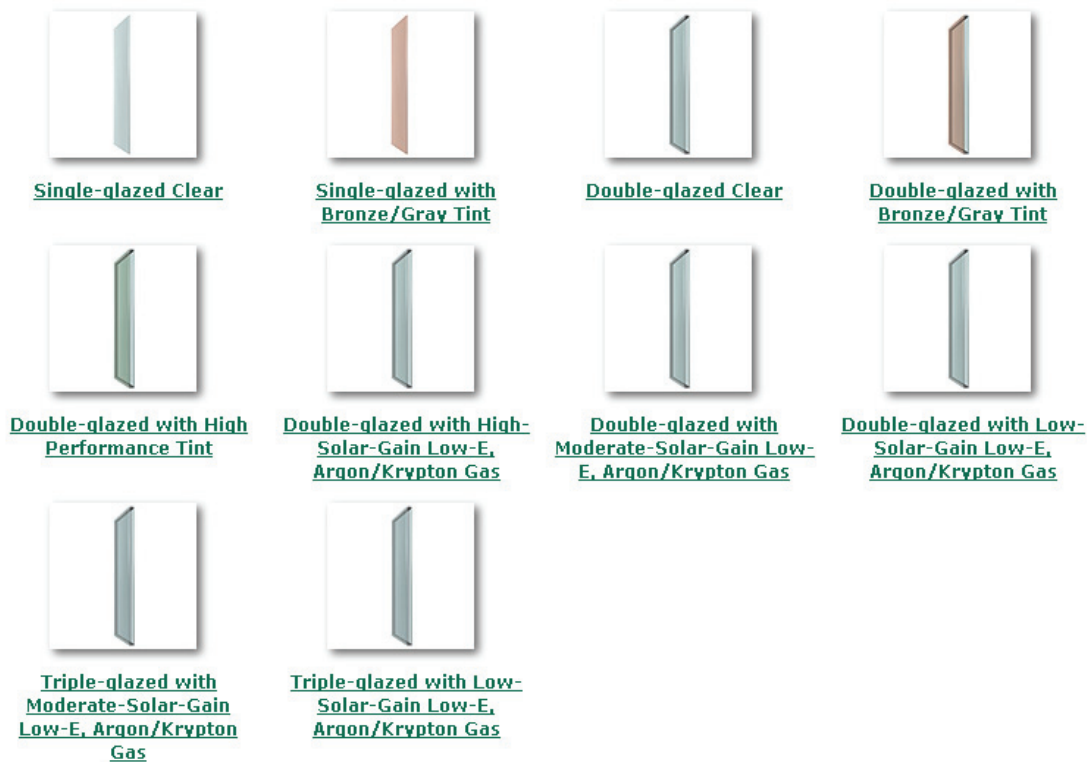


Figure 4. Classification of glazing types/window glass panes (<http://www.efficientwindows.org/gtypes.cfm>).

Table 2. Typical U_g -values for window glazings depending on number of glasses, choice of cavity gas and number of low emissivity coatings (E = low emissivity coating, each cavity 12 mm, 4 mm thick glasses).

Glazing U-value (W/(m ² K))				
Glazing Configuration (mm)		Cavity Gas		
		Air	Argon	Krypton
No low emissivity coating	4	5.8	-	-
	4-12-4	2.9	2.7	2.6
	4-12-4-12-4	2.0	1.9	1.7
Low emissivity coating	4-12-E4	1.6	1.3	1.1
	4-12-4-12-E4	1.3	1.0	0.8
	4E-12-4-12-E4	1.0	0.7	0.5

3.3 Window Frame Types

The various window frame types are at this stage divided into the groups listed below. This division is based on the actual frames found in the market review (see Chapter 5). Other window frame classification systems may also be found, e.g. the one given in <http://www.efficientwindows.org/ftypes.cfm>. In this report, the subdivisions are made according to the structural load carrying element for the opening windows (a fixed frame group and a glass facade system group have also been specified - for further details see Chapter 5.1):

- Wood frame
- Wood frame with insulation-filled Al cladding
- PVC frame
- PVC frame with insulation filled Al cladding
- Al frame
- Fixed wood and Al frame
- Glass facade system

All these frames include insulating materials in addition to the structural materials.

As noted above typical window frames seldom reach U_f -values below $1 \text{ W/m}^2\text{K}$. They normally have U_f -values quite a bit larger than $1 \text{ W/m}^2\text{K}$. The U_f -value for wood frames is mainly decided by the thickness of casement and frame in the heat flow direction. Typical thicknesses are between 80 and 100 mm for the casement and between 60 and 70 for the frame. This results in a mean U_f -value for casement and frame of 1.5 to $1.7 \text{ W/m}^2\text{K}$. For plastic frames the U_f -value is between 1.6 and $2.8 \text{ W/m}^2\text{K}$, and is mainly dependent on the number of air cavities and the location of the load carrying element which usually is of metal. Window frames constructed of metal, usually aluminum, should be constructed of one outer and one inner profile and separated by an insulating material (a thermal break), i.e. polyamide. The thermal break is necessary to meet low U-value requirements and also to achieve acceptable surface temperatures. Traditionally metal frames have had a high U_f -value, but new aluminum frames with a thermal break may have U_f -values varying from about 1.4 to $2.8 \text{ W/m}^2\text{K}$.

4 Window Frames Research

This chapter presents various topics related to the thermal performance of window frames found in research papers and reports. The main focus has been on reports and papers that only study the window frame. But because the frame usually is a part of a complete window, research on topics related to windows in general is also presented. For these reports and papers the issues related to the frame and focusing on energy rating topics have been selected. Research focusing on the glazing and glazing topics are not referred in detail.

4.1 Effect of Frame and Spacer on Window U-Value

The thermal performance of the window frame has an effect on the thermal performance of the entire window, because the U-value of the entire window is an area-weighted average of the individual components (glazing, edge and frame). A good window frame will therefore influence the total window U-value positively compared to a poor window frame.

Carpenter and McGowan (1989) studied the effect of various frames and spacers on the thermal performance of the entire window. They found that double-glazed windows with insulation spacers have a 6% lower U-value than those with aluminum spacers. Furthermore, insulating spacers can reduce the total window U-value by as much as 12% in high-performance windows (three glass panes), as compared with aluminum spacers. (Further, they also found that the U-value of aluminum frames is 39 % higher than wood frames for standard double-glazed windows and up to 52 % higher for high-performance glazings. The frame U-values ranged from 11.2 W/m²K for aluminum frames and 2.1 W/m²K for wood frames. They used a method similar to the alternate method in ISO 15099 to calculate the frame U-value. That is, the frames were simulated with glazing and spacer, not with an insulation panel to find the frame U-value.)

4.2 Thermal Performance Improving Measures

There are several ways of improving the thermal performance of windows and frames in particular. There are also several ways of assessing if one product has a better performance than another product. With regard to window frames the thermal transmittance (U-value) seems the most appropriate way of assessing the thermal performance. But when the ultimate goal is a complete window (glazing and frame) with a good thermal performance, other measures may also be useful, like the *Net energy gain* method presented above. Using the latter method may show that a window with a U-value of 0.97 W/m²K (frame U-value equal to 1.49 W/m²K) have a higher net energy gain than window with a U-value of 0.79 W/m²K (frame U-value equal to 0.75 W/m²K), Loutsen and Svendsen (2005). The reason for this is that the former window has a larger glazing area than the latter window.

With regard to frame U-value, one may look at changing the geometry as an option to modify the thermal transmittance. Replacing high-conductivity materials with low-conductivity materials is another way to reduce the thermal transmittance of frames. Here we present measures that various researchers have investigated in order to improve the frame's or the window's thermal performance.

In 1992 Byars and Arasteh examined various design options for reducing the frame U-value. They studied the effect of substituting wood (conductivity equal to 0.1159 W/mK) with an insulating material and also substituting the glazing spacer with an insulating material (conductivity equal to 0.0294 W/mK). The insulating material for the frame was not a real material with the structural properties needed for a window frames, but rather a material with the wanted thermal properties (reported in percentages of the conductivity of wood). The authors found that reducing the thermal conductivity of the jamb and sash from 100% of the conductivity of wood to 50% and 10% of the conductivity of wood for the sash and jamb, respectively, resulted in a U-value decrease from 1.48 to 0.57 W/m²K (with an insulated spacer). The authors also investigated the effects of varying cladding thickness and fill materials on "clad frame" frame U-values. They found that changing the fill material from wood to an insulating material was more important than changing the clad thickness (i.e. from 2 mm to 1 mm). Once the fill was insulated the, the cladding thickness and conductivity became important.

Two papers, Noyé and Svendsen (2002) and Lautsen and Svendsen (2005), describe how the *Net Energy Gain* method can be used to find better window designs. As explained above, this method takes both the thermal losses and the gains into consideration. The window with the largest net energy gain does therefore not necessarily have the lowest frame U-value. Lautsen and Svendsen (2005) examine 7 different window designs. The design of the two windows having the largest net energy gain is presented below.

The window with the largest net energy gain (18 kWh/m² for Danish climate) is shown in Figure 5. It is a proposal, and the frame construction is made of fiber glass reinforced polyester, which is both very slim and deep. There is room for three glass panes with an unusually large gap, which has the effect that the depth of the frame is as much as 150 mm. The frame can be made even deeper for walls with more thermal insulation. The total area of the window is 1.23 m × 1.48 m and the frame width is 25 mm. Thus, the glass percentage is 93%. The frame U-value is 1.49 W/m²K, the centre U-value of the glazing is 0.93 W/m²K, and the g-value is 0.58. A version of this window with shutters on the outside was also tested, and this window produced even a larger net energy gain. The main idea behind this design, besides increasing the overall solar energy transmittance from the window, is that it should not be necessary to reduce the insulation thickness in the wall where the window is mounted (Schultz and Svendsen, 2000, and Schultz, 2002). A traditional and the new design are shown in

Figure 6. For the new design the thermal bridge effects in the wall can be minimized or eliminated. The thermal bridge effect by the frame itself is also minimized. The inner and outer pane of the window has a hard coat low emissivity layer. Another advantage with this design is that it does not have a sealed glazing unit. This should increase the life time of the product (Schultz, 2002).

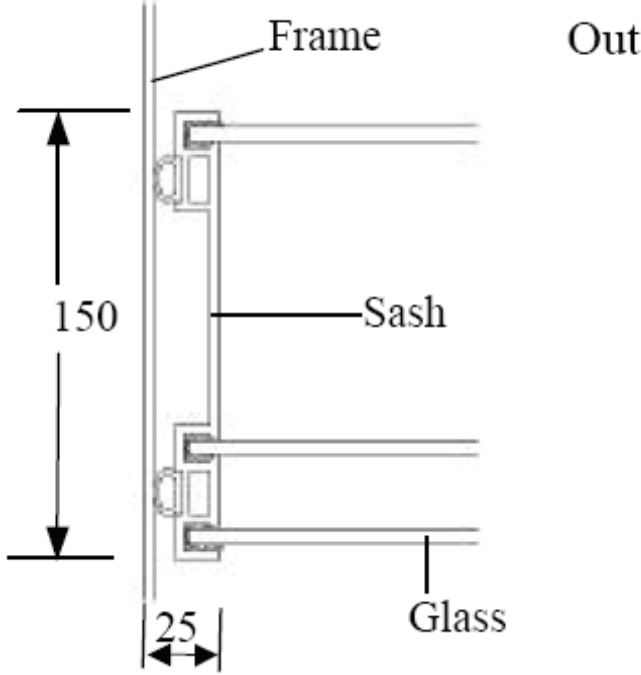


Figure 5. Frame profile made from fiber glass reinforced polyester with three layers of glass (Lautsen and Svendsen, 2005). The frame U-value is $1.33 \text{ W/m}^2\text{K}$.

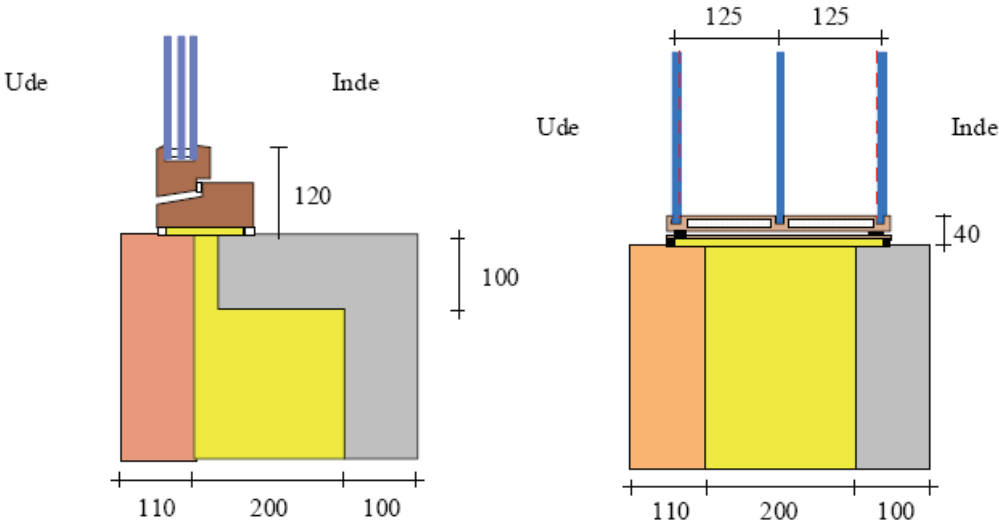


Figure 6. Traditional and new window designs illustrating how thermal bridges in the wall around the windows can be reduced by using a wide window. (Schultz, 2002).

The window with the second largest net energy gain (-2 kWh/m^2 for Danish climate) has a frame profile that is made of wood covered with aluminum, see Figure 7. The glazing has a double layer low energy glazing 4-15-4 mm with 90% argon filling and a low-emissivity coating on the inner pane on the surface facing the gap. In order to achieve a high g-value the outer pane is made of float glass with low iron content. The spacer is made of plastic with a very thin stainless steel film. The height of the frame is reduced by about 5 cm compared to a traditional wood frames by moving the sash out in front of the outer frame. The glazing area is therefore increased by 15% compared to a similar window of wood where the frame width is 10 cm (window dimensions: 1.48 x 1.23 m). A large width is selected to reduce the thermal bridge between the window and the wall.

A Passivhouse window was also simulated. This frame gave a net energy gain slightly smaller (more heat loss) than the second best frame. This window had a U-value of $0.77 \text{ W/m}^2\text{K}$, with a frame having a U-value of $0.75 \text{ W/m}^2\text{K}$. This frame is shown in Figure 8.

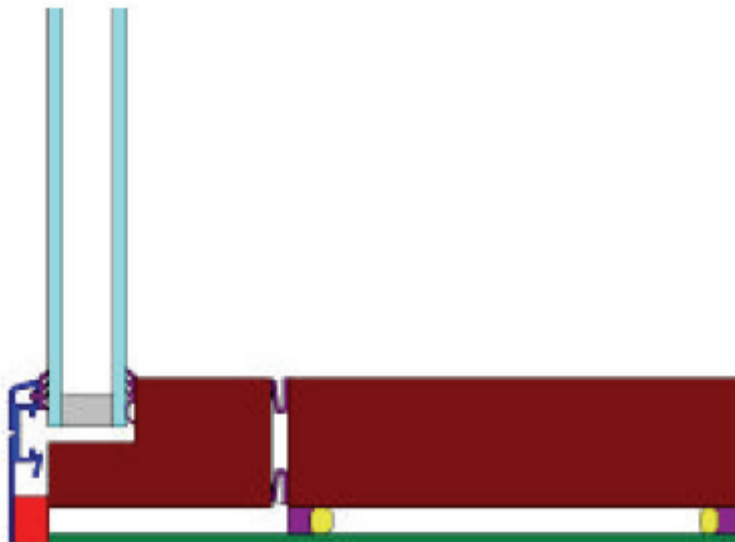


Figure 7. Slim frame profile (5 cm) made from wood covered with aluminum (Lautsen and Svendsen, 2005). The frame U-value is $1.33 \text{ W/m}^2\text{K}$.

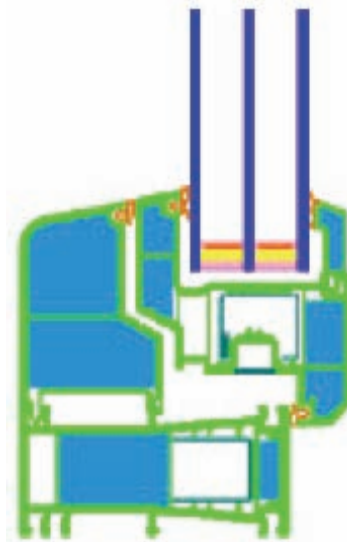


Figure 8. A window satisfying the PassivHaus requirements. The frame is made of a PVC frame profile with PU foam in the cavities (Lautsen and Svendsen, 2005).

Some authors have also investigated the effect of frame geometry on new and emerging technologies, such as an electrochromic vacuum glazed window. Fang and Eames (2006) found that the frame rebate depth had a significant influence on the window U-value. Calculations of the thermal performance of a vacuum glazing (two glass panes) in a solid wood frame with rebate depths of 0 to 22.4 mm have been carried out (see Figure 9). The emissivity of the coatings on the two glass surfaces within the evacuated gap was 0.18. Over the depth of rebates considered, the U-value of the total window area (glazing had a size of 0.4 by 0.4 m²) decreased from 1.4 to 0.83 W/m²K. The U-value of the center glazing area decreased from 1.04 to 0.82 W/m²K. The authors also examined the effect of rebate depth on an electrochromic vacuum glazed window. The construction was similar to the one shown in Figure 9, but with the glass pane to the left replaced with an electrochromic glazing system. Thus, the total width of the entire glazing system was wider than for the vacuum window alone. For this construction the total window U-value decreased from 1.48 to 1.13 W/m²K when the rebate depth increased from 0 to 22.4 mm. The center U-value changed from 0.98 to 0.80 W/m²K.

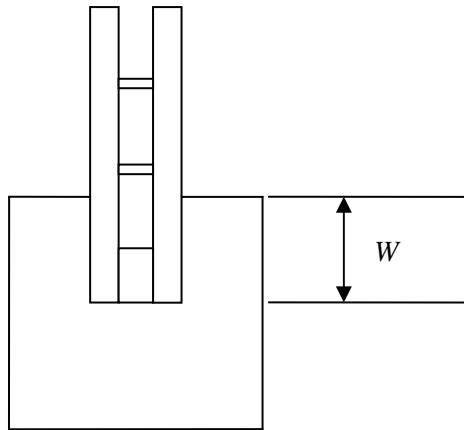


Figure 9. Schematic showing of a vacuum glazing with a wood frame. W is the rebate depth. The size of the pillars separating the glass panes in the figure is not comparable to a real vacuum window.

4.3 3D and Other Effects on Thermal Performance

Griffith et al. (1998b) and Carpenter and McGowan (1998) studied heat transfer in curtain-wall aluminum frames and focused on the effect of the bolts on the heat flow and the temperature distribution on the warm side surface of the specimens. Both studies conclude that it is important to include the bolts when the thermal performance of the frames is found. They also found that two-dimensional program gives accurate results when appropriate calculation procedures are applied.

Hallé et al. 1998 studied the effect of air leakage on the heat transfer in window frames with internal cavities. They used computational fluid dynamic (CFD) techniques to simulate air leakage effects. The frame cavities were treated as solids. Two window frames (an aluminum frame with a PVC thermal break and a PVC frame) were examined with air leakage rates of 1.65 and 0.55 m³/h per meter crack length. For the infiltration case the authors found that the air-frame interaction caused the air to be preheated by the frame. This decreased the apparent thermal transmittance of the frame. For the exfiltration case, air increases the frame temperature, which increases heat losses and the apparent thermal transmittance of the frame.

4.4 Heat Transfer Modeling of Window Frame Cavities

A large part of the work related to heat transfer issues in fenestration cavities has focused on the glazing cavity. The goal has mostly been to develop accurate correlations for natural convection effects inside multiple pane windows (see e.g. Batchelor 1954, Eckert and Carlson 1961, Hollands et al. 1976, Raithby et al. 1977, Berkovsky and Polevikov, 1977, Yin et al. 1978, ElSherbiny et al. 1982a, Shewen et al. 1996, Wright 1996, or Zhao 1998). Most of these papers study natural convection between two high vertical isothermal walls separated by two horizontal adiabatic or

perfectly conducting walls (a two-dimensional cavity). Some of these studies are also relevant for frame cavities. The natural convection correlation used to find the effective conductivity for certain frame cavities are from some of these studies.

Studies of heat transfer in multiple pane windows also include findings of which Rayleigh numbers there will be secondary (or multicellular) flow (see e.g. Korpela et al. 1982, Lee and Korpela 1983, Zhao et al. 1997, Lartigue et al. 2000). Secondary flow enhances heat transfer through glazing cavities, and may also take part in frame cavities of a certain shape, see Gustavsen and Thue (2007).

In solid window frames the heat flow is carried out by conduction, which can be simulated with standard conduction simulation software. In window frames with internal cavities the heat transfer process is more complex, involving combined conduction, convection and radiation. Ideally, to fully describe heat transfer through such window frames there is a need to simulate fluid flow to find the convection effects and to use either view-factors or ray-tracing techniques to find the radiation effects inside the cavities. But because of computational resources and the additional modeling efforts these simulations often require, such simulations still are rare. Instead air cavities are transformed into solid materials with an effective conductivity; that is, the conduction, convection and radiation effects are combined into an effective conductivity. Then, like for solid window frames without internal cavities, standard conduction simulation software can be used to find how well such sections insulate, or the U-value. Some computer packages (like e.g. Blomberg 2000, Enermodal 2001 or Finlayson et al. 1998) do find the effective conductivity automatically, by applying procedures specified in international standards (ISO 15099 or ISO 10077-2). In some computer programs it is also possible to use view-factors to calculate the radiation heat transfer effects (Finlayson et al. 1998).

Some studies have been performed with focus on heat transfer effects in window frames, and with focus on window frames with internal cavities. Standaert (1984) studied the U-value of an aluminum frame with internal cavities. The cavities were treated as solids and effective conductivities were assigned to each cavity. The effective conductivities of cavities not completely surrounded by aluminum were calculated from a fixed thermal resistance of $R = 0.37 \text{ m}^2\text{K}/\text{W}$ ($\lambda_{eq} = L/R$ where λ_{eq} is the equivalent conductivity and L is the length of the cavity in the heat flow direction). Cavities completely surrounded by aluminum were assigned an effective conductivity of $0.1 \text{ W}/\text{mK}$. The thermal transmittance of the frame studied was $5.9 \text{ W}/\text{m}^2\text{K}$. Jonsson (1985) and Carpenter and McGowan (1989) also treated air in window frame cavities as solids and used equivalent conductivities to calculate heat flow. In their studies the effective conductivity concept was formulated as,

$$\lambda_{eq} = \lambda_{air} \times Nu + \frac{h_R \times L}{[1/\varepsilon_H + 1/\varepsilon_C - 1]} \quad (1.1)$$

where λ_{eq} is the equivalent conductivity, λ_{air} is the conductivity of air, Nu is the Nusselt number, L is the length of the air cavity, ε_H and ε_C and are the emissivities of the warm and cold sides of the cavity walls, respectively. h_R is the black-body radiative heat transfer coefficient, which depends on temperatures of the interior walls of the cavity and also on cavity geometry. Jonsson (1985) used $h_R = 3.3 \text{ W/m}^2\text{K}$ for different cavity geometries while Carpenter and McGowan (1989) report different h_R values, depending on cavity height to length aspect ratios. The frames studied by Carpenter and McGowan (1989) had U-values between 2.1 and 11.2 $\text{W/m}^2\text{K}$. The former value is for a wooden frame and the latter value for an aluminum frame. Jonsson (1985) examined windows with U-values between 2.79 and 4.23 $\text{W/m}^2\text{K}$.

Svendsen et al. (2000) and Noyé et al. (2001) examined the accuracy of the radiation procedures prescribed in EN ISO 10077-2 and found that using view-factors to account for radiation instead of the simplified correlation in EN ISO 10077-2, results in U-values that compare better with measured results. The natural convection correlations of EN ISO 10077-2 were used. Two frames were examined, one thermally broken aluminum frame and one frame made of PVC. Svendsen et al. (2000) found that division of air cavities also affects the U-value, but not as much as the change of radiation model.

Gustavsen (2001) studied heat transfer in window frames with internal cavities, and focused mainly on convections effects. Most of the results were published in papers and are reported below. Some results are however only available in the introduction part of the thesis; these will be reported here. Gustavsen (2001) compares the frame cavity convection correlations from various standards to relevant correlations found in the literature. He found that the Nusselt number correlations that are to be used for horizontal window frames according to ISO 15099 not necessarily is accurate for frame cavities with a height to length aspect ratio between 0.5 and 5, because ISO 15099 prescribes that interpolation have to be used for these geometries. (The correlation for cavities with an aspect ration smaller than 0.5 is based on analytical consideration, while the correlation for high aspect ratio cavities, $H/L > 5$, is based on experiments for typical glazing enclosures.) For some geometries and Rayleigh numbers the correlation works but for others the correlation predicts Nusselt numbers that are not correct. Further, the author found that the convection correlation prescribed for frame cavities in ISO 10077-2 only is valid for vertical frame cavities.

Gustavsen and coauthors have studied several aspect of heat transfer in window frames with internal cavities. In Gustavsen et al. (2001a), they used infrared thermography to verify that a CFD code was capable of simulating the natural convection effects taking place in window frames with internal cavities. In a follow-up study the authors (Gustavsen et al. 2001b) examined three-dimensional convection effects in simple window frames with internal cavities and concluded that it appears that the thermal transmittance (U-value) of a four-sided section sections (with one open internal cavity) can be found by calculating the area weighted average of the thermal transmittance of the respective single horizontal and vertical sections. However, precise surface temperature predictions require three-dimensional simulations, especially for the corners of the frames (see Figure 10). In addition, the authors concluded that two-dimensional heat transfer simulation software agrees well with CFD simulations, with regard to heat transfer rates for the simple square-shaped frames simulated, if the natural convection correlations used for the internal cavities were correct.

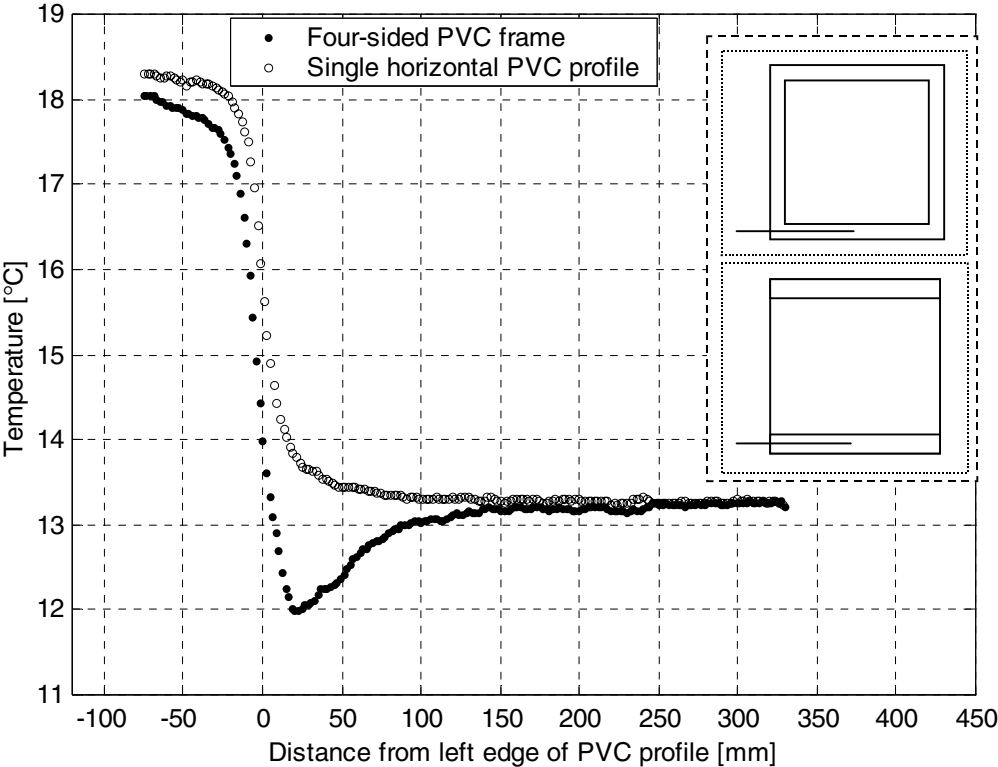


Figure 10. Temperatures along the left lower horizontal part of the four-sided two-inch PVC frame compared to the surface temperatures along the middle of the lowest two-inch profile in the configuration made up of two separate horizontal profiles (Gustavsen et al. 2001b).

Gustavsen et al. (2005) used computational fluid dynamics (CFD) modeling to assess the accuracy of the simplified frame cavity conduction/convection models presented in ISO 15099 and used in software for rating and labeling window products. Three (horizontal) representative complex cavity cross-section profiles with varying dimensions and aspect ratios were examined, see Figure 11. Stream

contour plots, Figure 12, and heat transfer rates were presented. The results supported the ISO 15099 rule that complex cavities with small throats should be subdivided; however, the authors suggest that cavities with throats smaller than 7 mm should be subdivided, in contrast to the ISO 15099 rule, which places the break point at 5 mm. Further, the authors found that the agreement between CFD modeling results and the results of the simplified models was moderate for the heat transfer rates through the cavities. This was explained by inaccuracies in the underlying ISO 15099 Nusselt number correlations being based on studies where cavity height/length aspect ratios were smaller than 0.5 and greater than 5 (with linear interpolation assumed in between).

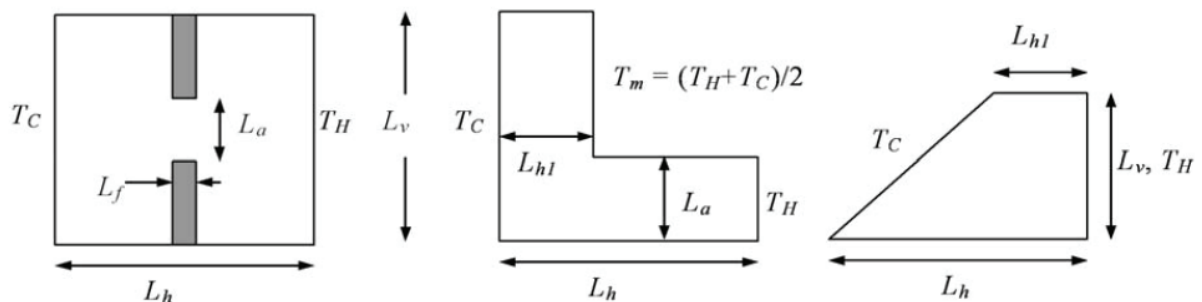


Figure 11. Schematics of cavities studied by Gustavsen et al. (2005). The height and the width of the two cavities to the left were 30 mm. The right cavity had a width of 30 mm and the height was 10 mm and 20 mm. L_a was varied to between 0 and 30 mm for the cavity to the left and 3 and 15 mm for the cavity in the middle.

Gustavsen et al. (2007) used two-dimensional computational fluid dynamics (CFD) and conduction simulations to study heat transfer in horizontal window frames with internal cavities (the above mentioned paper studied only cavities). Temperatures and U-values for typical horizontal window frames with internal cavities are compared; results from CFD simulations with detailed radiation modeling are used as a reference. Four different frames were studied. Two were made of polyvinyl chloride (PVC) and two of aluminum. For each frame, six different simulations were performed, two with a CFD code and four with a building-component thermal-simulation tool using the Finite Element Method (FEM). The FEM tool addresses convection using correlations from ISO 15099; it addressed radiation with either correlations from ISO 15099 or with a detailed, view-factor-based radiation model. The practice of subdividing small frame cavities was examined, in some cases not subdividing, in some cases subdividing cavities with interconnections smaller than five mm (according to ISO 15099) and in some cases subdividing cavities with interconnections smaller than seven mm. For the various frames studied (two were made of aluminum and two of PVC), the calculated U-values were found to be quite comparable (the maximum difference between the reference CFD simulation and the other simulations was found to be 13.2 percent). A maximum difference of 8.5 percent was found between the CFD simulation and the FEM simulation using ISO 15099 procedures. The ISO 15099 correlation works best for frames with high U-factors. For more efficient frames, the relative

differences among various simulations are larger. Finally, the effectiveness of the ISO cavity radiation algorithms was examined by comparing results from these algorithms to detailed radiation calculations (from both programs). The author conclude that improvements in cavity heat transfer calculations can be obtained by using detailed radiation modeling (i.e. view-factor or ray-tracing models), and that incorporation of these strategies may be more important for improving the accuracy of results than the use of CFD modeling for horizontal cavities. Figure 13 shows a stream contour plot for one of the PVC frames studied.

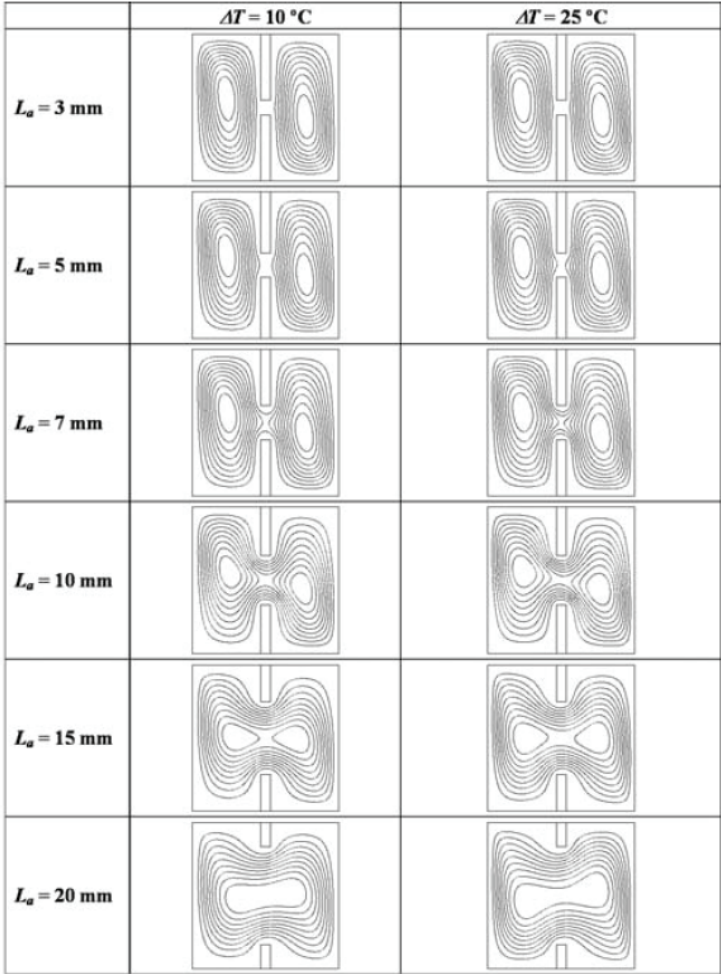


Figure 12. Stream contours for the cavity to the left in Figure 11 (named the H-cavity). L_a is the size of the gap opening, and ΔT is the difference between the hot and cold wall temperatures, reported in $^{\circ}\text{C}$.

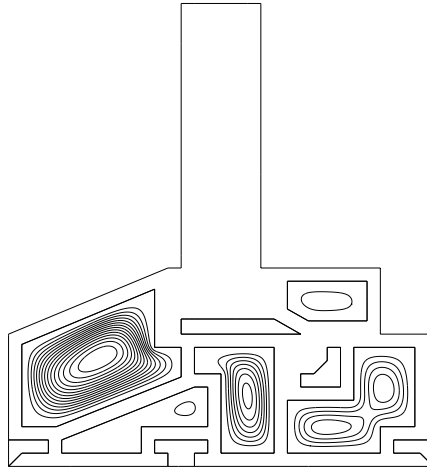


Figure 13. Stream contours for one of the PVC frames studied by Gustavsen et al. (2007).

Gustavsen and Thue (2007) used a commercial computational fluid dynamic program to study the effect of the horizontal aspect ratio (W/L) on heat flow through three-dimensional cavities with a high vertical aspect ratio (H/L). These are the kind of cavities that can be found in vertical window frames, see Figure 14. The cavities studied have two opposite isothermal vertical walls separated by four adiabatic walls. The vertical aspect ratios are 20, 40, and 80 and the horizontal aspect ratios range from 0.2 to 5. Simulations of two-dimensional cavities are also included. The simulations show that three-dimensional cavities with a horizontal aspect ratio larger than five can be considered as being two-dimensional cavities to within 4% when considering heat transfer rates. A complex flow was also found, for several of the cavities; one example is shown in Figure 15. Nusselt number correlations for the different horizontal aspect ratios are presented.

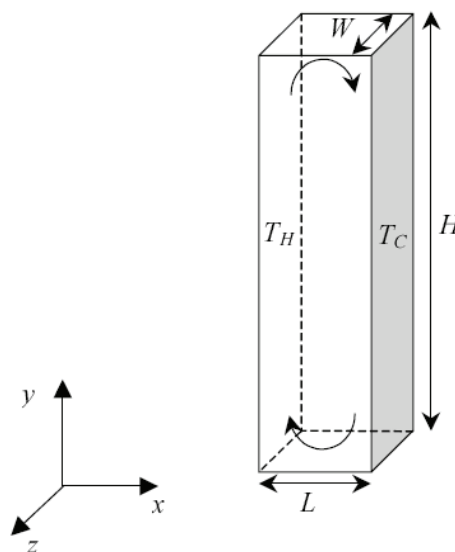


Figure 14. Geometry studied by Gustavsen and Thue (2007). The vertical aspect ratios, H/L , were 20, 40, and 80 and the horizontal aspect ratios, W/L , ranged from 0.2 to 5.

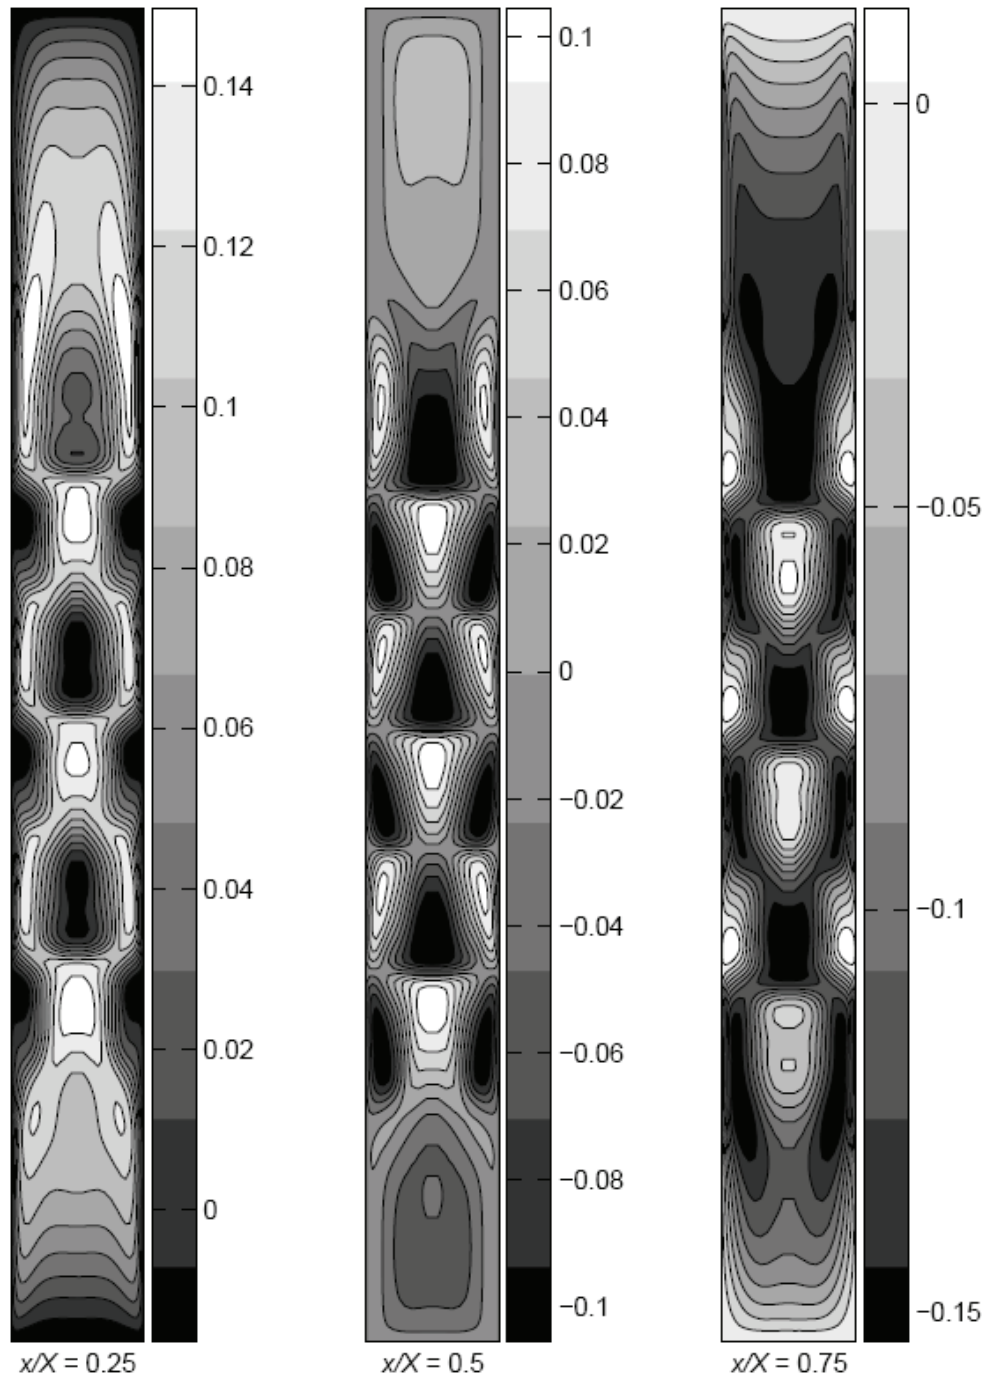


Figure 15. y -velocity contours (m/s) at different planes in a cavity where $(H/L, W/L) = (40, 2)$. The Rayleigh number was equal to 2×10^4 . Each plane is parallel to the y - z -plane in Figure 14. X is the total length of the cavity. The x -vector is pointing into the page, the y -vector is pointing from bottom to top, and the z -vector is pointing from left to right. The figures are not in the correct scale (Gustavsen and Thue, 2007).

Fomichev and co-workers have also studied heat transfer effects in the kind of cavities that can be found in horizontal and vertical frame cavities (Fomichev et al. 2007). They used both experimental and numerical techniques (two- and three-dimensional CFD simulations) and studied the effect of the aspect ratios (horizontal and vertical) as well as tilt angle on the heat transfer rates. They concluded

that two-dimensional modeling is appropriate to predict natural convection heat transfer in horizontal frame cavities (such as the ones found in frame head and sill) tilted around the long axis. They further concluded that three-dimensional simulations is needed to predict natural convection heat transfer in frame cavities tilted around the short axes, such as the ones found in vertical frame sections (jambs, and vertical meeting rail and mullion cross-sections). Fomichev et al. (2007) also note that the frame cavity correlation equations suggested by ISO 15099 for vertical frame cavities do not correlate well with their three-dimensional CFD simulation results. The authors suggest new correlations for both horizontal frame sections (vertical aspect ratios between 0.5 and 5) and vertical frame sections (vertical aspect ratios between 20 and 40, and horizontal aspect ratios between 0.5 and 2). The correlations depend on both Rayleigh number and tilt angle (in addition to the aspect ratios). Fomichev et al. (2007) in addition did some studies of the convection heat transfer effects for ventilated frame cavities.

4.5 Exterior and Interior Surface Modeling

When the thermal performance of fenestration products is found, through the calculation of the U-value, surface conditions (surface resistances) are among the properties. And like for modeling of internal frame cavities, these properties will pay a more important part for high performance frames than for frames with a poorer performance. Accurate treatment of the surface conditions is therefore important, to be able to accurately predict the thermal transmittance and also to distinguish between various designs with regard to obtaining desired glass/frame surface temperatures.

Curcija and Goss (1993) used a finite element method to study two-dimensional, laminar convection over an isothermal indoor fenestration surface (glazing/frame assembly). Results were reported for three typical configurations: glazing with no frame, a single-step frame and a double-step frame. The authors present local indoor surface convective heat transfer coefficient to be used in two- and three-dimensional heat transfer analysis of fenestration systems (valid both for the glazing and the frame part of the product).

Carpenter and Elmahdy (1994) examined the thermal performance for four complex fenestration systems (flat glazed skylight, a domed skylight, a greenhouse window and a curtain wall) using computer simulation tools and guarded hot box testing. They found discrepancies of up to 16 % between the simulated and measured cases, and explain the difference by uncertainties in the warm and cold side film coefficients and lower warm-side air temperatures because of stagnant airflow. They also found that that the thermal simulations must account for thermal bridges like bolts in curtain walls and curbs in skylights.

In 1994 Curcija and Goss investigated three different ways of modeling heat transfer boundary conditions for complete (two-dimensional) fenestration systems (with wood frame). A computation fluid dynamics (CFD) program was used in order to allow for fluid flow in the glazing cavity. Two of the surface models incorporated fixed indoor and outdoor coefficients and one incorporated variable (position dependent) coefficients. Component and overall U-factors were compared. The authors found that the U-values from using variable boundary conditions generally were lower than the ones calculated using constant surface heat transfer coefficients. The average difference was approximately 15 %. Curcija and Goss (1994) further noted that the effects of variable boundary conditions, which more accurately model local heat transfer on the indoor and outdoor fenestration surfaces, create “insulated” zones in the vicinity of the edge-of-glass region, which can significantly change the local heat transfer and temperature distribution when compared to constant-boundary-condition situations. This effect of lower heat transfer in these “insulated” zones could be used in the design process, so that altering the frame design on either side of the frame could create more pronounced outdoor insulated zones and less pronounced indoor insulated zones, therefore improving the condensation resistance of the fenestration system. The results also showed that the edge-of-glass area used when simulating frame and edge of glass (with spacer) should not be defined as 63.5 mm (2.5 in) from the sight line, since 102 mm (4 in) is a more realistic measure.

In 1998 Griffith et al (1998a) and Arasteh et al (1998) examined how improved radiation modeling (using view-factor models instead of fix coefficients) could improve the prediction of surface temperatures when modeling projecting fenestration products. Griffith et al (1998a) found that using view-factor modeling could improve the accuracy of the models for predicting surface temperature and lower the results for U-values for projecting windows (skylights, greenhouse windows).

Branchaud and co-workers examined the local heat transfer taking place in open frame cavities (open to the exterior environment) in 1998. The study shows that there can be a significant variation of the local convective heat transfer coefficient on the outdoor surface of a fenestration system. The variation is mainly a result of the products geometry. Based on the CFD simulations carried out, the authors find that significant convective heat transfer effects extend only up to one times the width of the cavity opening, for the cavities studied.

Schrey et al. (1998) studied the local heat transfer coefficient for two flush-mounted glazing units. One of the glazings had a foam spacer while the other one had an aluminum spacer. No window frame was included in the studies. Wright and Sullivan (1994) used a two-dimensional CFD code to study the natural convection effects in a vertical rectangular window cavity, but did not consider frame heat transfer. Secondary flow was also reported.

4.6 Spacer Research

The glazing spacer and the location of the spacer in the frame may influence the thermal performance of the window, as seen in some of the reported work above. We therefore also include the result from some papers related to spacer research, although the focus in this report is on the window frame.

Elmahdy and Frank (1993) studied the effect of various spacers on the surface temperature of double pane glazings, without frame. Hot box measurements and finite-difference modeling were performed. Four different spacers were considered: Aluminum spacer, silicone foam spacer, a corrugated metal spacer and a thermally broken metal spacer. As expected, as the thermal resistance of the spacer bar increases, the glass surface temperature on the warm side of the spacer bar increases and the glass surface temperature on the cold side decreases. They also modeled the various glazing/spacer configurations inserted in a simple wood sash, and found that the difference in the glass surface temperatures between the various configurations was smaller as a result of the added sash. Elmahdy and Frank (1993) expect the differences to get even smaller for thicker frame profiles.

Löffler (1997) and Löffler and Buck, (1997) presents foamglass as a possible spacer material, and investigates the possibility for windows without a frame. The authors claim windows without a frame will have a transparent area which is 10 to 15 cm larger at each edge. This will increase the solar gain and at the same time reduce the heat loss from window (if the frame has a lower heat resistance than the glazing).

Elmahdy (2003) describes several different spacer types, see Figure 16, and examines the thermal performance of various spacers by experiments. The spacers were mounted between two clear glass panes, and with air in the glazing cavity. The size of the specimens was 152 mm by 1200 mm. The specimens were tested without and with frames.

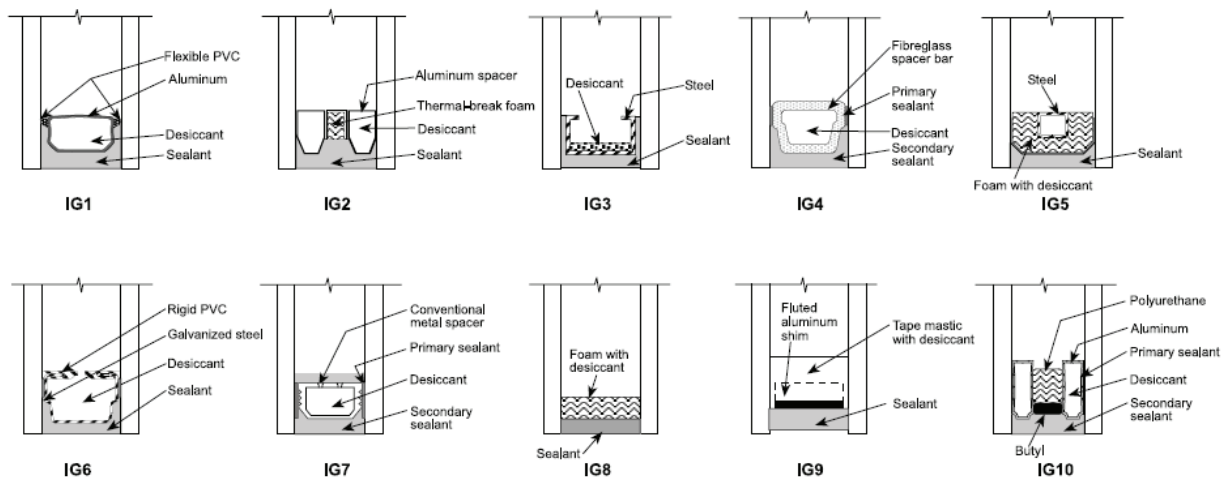


Figure 16. Spacer bar assemblies studied by Elmahdy (2003).

By examining warm-side glass surface temperature of the various glazing units, Elmahdy (2003) found that IG8 had the highest temperature. Units IG 4 and IG9, which almost experienced the same temperatures, had the second highest temperatures. Thus, these units are therefore best suited for reducing warm-side surface condensation. Unit IG7 had the lowest surface temperature while unit IG5 had the second lowest temperature. The temperature difference between the best and the poorest-performing units was 6 K. The temperatures on the warm and cold sides of the specimens were 21 and -18 °C, respectively. The experiments showed that the warm-side surface temperature for all specimens were almost the same when moving away from the edge-of-glass region (about 60 mm from the spacer). Glazing units (1000 mm by 1000 mm) were also tested as part of a complete window. The frames were made of various materials (redwood, vinyl, thermally broken aluminum and foam-filled fiberglass). The foam-filled fiberglass frame combined with glazing unit IG8 offered the warmest glass surface temperature (measured 10 mm from the lower sight line). The thermal resistance of each configuration (glazing/spacer/frame) was also tested, and it was found that the wood frame windows performed the best, regardless of spacer configuration. The only exceptions were for spacer bars IG4 and IG6, for which the thermal resistance values for the vinyl frame and the wood frame performed almost the same.

4.7 Evaluation of Condensation Risk

Several studies have been performed on evaluation of condensation risk in fenestration products. But, for high-performance products internal condensation should not be a problem. On the other side, external condensation may be a problem for the exterior pane of the glazing system. Still this is a problem for the glazing and not for opaque frames. This topic is therefore not covered in more detail here. Interested readers may be referred to e.g. Moshfegh et al. (1989), Carpenter and Hanam (2001), and Kohler et al. (2003).

4.8 Other Topics (Material Properties, etc)

In this chapter we present research that could not be sorted under the headings above. Most of the data are related to the material properties of typical and unusual frame materials.

Erten et al. (1996) investigated reinforced mosaic door and window frames as an alternative to wood frames to be used mainly in housing in the Eastern Black Sea region. These frames have been applied increasingly by the regional people in their houses. The paper deals with the production, application, details and failures of reinforced mosaic frames, but does not address the thermal properties of the frames, which probably is rather poor.

Jakubowicz and Möller (1992) examined a PVC window frame that had been naturally aged for 20 years. One of the main findings was that the heaviest degradation, detectable by IR spectroscopy, had

occurred in a relatively thin surface layer of about 100 μm . The surface degradation effects were also confirmed by impact strength measurements. Still, after removing the surface layer the impact strength was rather low compared with expected values for undegraded PVC. They therefore concluded that some kind of degradation also had occurred in the bulk material. Still, the PVC frame investigated would probably fulfill the requirements for approval according to most national standards.

Gustavsen and Berdahl (2003) studied the normal spectral emissivity of an anodized aluminum window frame profile, and an untreated aluminum profile. The normal spectral emissivity was measured in the wavelength interval from 4.5 to 40 μm (wavenumbers 2222 cm^{-1} to 250 cm^{-1}). Total emissivity values were also reported. Specimens were cut from the edge and from the middle of the six-meter long anodized aluminum profile. Specimens facing the internal cavities (thermal break cavity and all aluminum cavity) were measured. The authors found that the normal total emissivity is fairly constant (between 0.834 and 0.856) for exterior parts of the anodized profile and for surfaces facing the thermal break cavity. The normal total emissivity of the all-aluminum internal cavities was found to vary between 0.055 and 0.82, with the smallest value close to the middle of the profile.

Larsson et al. (1999) studied a super insulated window experimentally and numerically. The test was performed in steady state. A three pane glazing and wood frame was investigated. Fluid flow was simulated inside the internal cavities of the glazing while fixed film coefficients were used for the boundaries. A special test room was used for the experimental part of the work. The authors compared measured and calculated temperatures, and found good agreement between numerical and experimental results.

5 Market Review of Window Frames

Highly thermal insulating window frames found in the market are presented, where the U-values for the frames are given (U_f). The U_f -values are calculated according to Eq. (6); that is, an insulation panel is used instead of the actual glazing system, according to ISO 10077-2. The frame configurations with the various materials used are given together with some drawings, photos and temperature profiles. In addition, some other properties are given, e.g. window glazing U-value (U_g), total window U-value (U_w), linear thermal transmittance (Ψ), window glass pane spacer used and physical dimensions ($w \times h$). This report gives a selection of the window frames found. The Appendix contains a more complete list.

In this report the authors wanted to collect and present the best window frames available, with their respective frame U-value. In the search for such frames the authors quickly found out that some of the best available frames on the market were the ones presented and rated by the Passivhaus Institute in Germany. To fulfill the Passivhaus requirements the window frames need to have U_f values (window frame) so that $U_w \leq 0.80 \text{ W/m}^2\text{K}$ (window as a whole) (see Chapter 2.3). Since the frames complying with the Passivhaus Institute requirement seem to be the best ones out there (when the U-value is used as rating parameter), it was decided to focus on these frames. That is; in order for a window frame to be of interest, it had to comply with the requirement of the Passivhaus Institute. Most of the frames presented below and in the appendix are therefore rated by the Passivhaus Institute, and/or comply by their requirements. However, an extensive separate web-search was also performed, aiming at finding window frames with a low U-value. However, this search did not result in very many frames different from the frames rated by the Passivhaus Institute. A problem with some of the frames found was a lacking frame U-value. Sometimes the total window U-value was presented, but not always. The authors decided to present only frames with a known U-value. Some exceptions were however allowed, in order to allow for some frames made of a specific material or frames having a specific geometry.

Because of the above, and because the search was performed through Internet search engines with English and German search terms, the list will not be a complete one, including all window frames complying by the above mentioned criteria. However, the authors expect that the list presented in the Appendix, and the examples below, include most of the materials used, and give an overview over some of the best window frames (lowest U_f -value) available.

5.1 Various Window Frame Examples

Various window frame examples are given, where the main focus is to achieve as high thermal insulation properties (U-value) as possible. Both traditional window frame/casing systems and glass

facade systems are shown. For simplicity reasons the various window frames are (at this stage) divided into the following groups:

- Wood frame
- Wood frame with insulation filled Al cladding
- PVC frame
- PVC frame with insulation filled Al cladding
- Al frame
- Fixed wood and Al frame
- Glass facade system
- Window frame examples with higher U values than the Passivhaus requirement

The above frame subdivisions are made according to the structural load carrying element for the opening windows. In addition, a fixed frame group and a glass facade system group are also specified. With the wood, PVC, Al and wood/Al window groups it is implicitly meant (without stating it) that these frames incorporates larger volumes of a highly thermal insulating material (or several) in order to obtain a window U-value below $0.80 \text{ W/m}^2\text{K}$, which is the requirement for a Passivhaus window. Normal window frames consisting of only wood, PVC, Al or wood/Al, and thereby with higher frame U_f -values resulting in window U_w -values larger than $0.80 \text{ W/m}^2\text{K}$, are not dealt with in this context. As Al claddings may or may not be thermal insulated, and managing the Passivhaus requirement, it is added one wood and one PVC window frame group with insulation filled Al claddings.

5.1.1 Wood Frame

Examples of three wood window frames are given in Figure 17-Figure 19, where further details may be found in appendix. In these examples PUR is applied as a highly thermally insulating material inside the structural wood frame construction. Typically, as is also the case in these examples, the PUR elements are placed more or less in the middle of the frame.

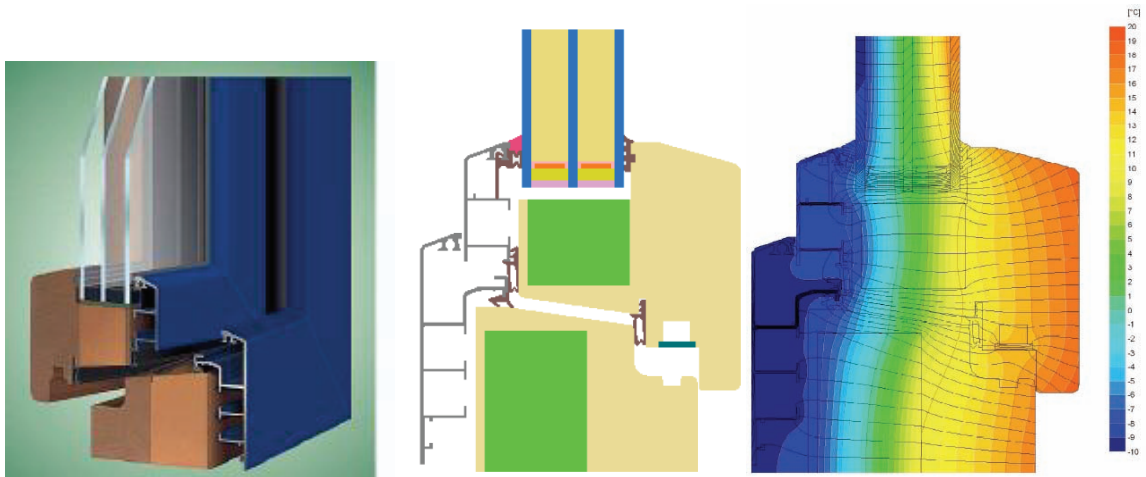


Figure 17. Example of a wood window frame with low U-value - Super-Warmfenster U 07 Serie HF 8120 by HEUSER Türen + Fenster-Metalbau GmbH. One photo to the left, one schematic drawing in the middle and one temperature profile to the right. Wood frame with PUR. Frame U-value $U_f = 0.65 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.heuser-tueren-fenster.de.

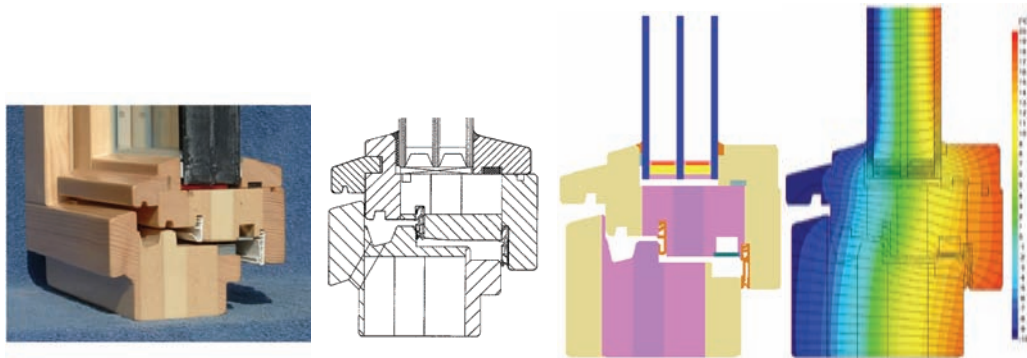


Figure 18. Example of a wood window frame with low U-value - VÖRDE-Passivhausfenster by H. Buck GmbH Fenster und Türen. Photos with corresponding drawing to the left, thereafter one schematic drawing and one temperature profile to the right. Wood frame with PUR and PUR recycled material (purenit). Frame U-value $U_f = 0.72 \text{ W/m}^2\text{K}$. This frame may be bought with and without Al cladding. From <http://www.passiv.de> and www.fenster-buck.de.



Figure 19. Example of a wood window frame with low U value - N Tech Passiv Superspacer by NorDan AS. Wood frame with PUR. The frame U-value is not stated, whereas the total window U-value is reported to be $U_w = 0.7 \text{ W/m}^2\text{K}$. From <http://www.nordan.no>.

5.1.2 Wood Frame with Insulation Filled Al Cladding

Examples of three wood window frames with insulation filled Al claddings are given in Figure 20-Figure 22, where further details may be found in appendix. In these examples PUR is applied as a highly thermally insulating material inside the structural wood frame construction and in the Al claddings. In addition, as seen for the frame in Figure 21, XPS may also be utilized. Typically, as is also the case in these examples, the PUR elements are placed more or less in the middle of the frame.

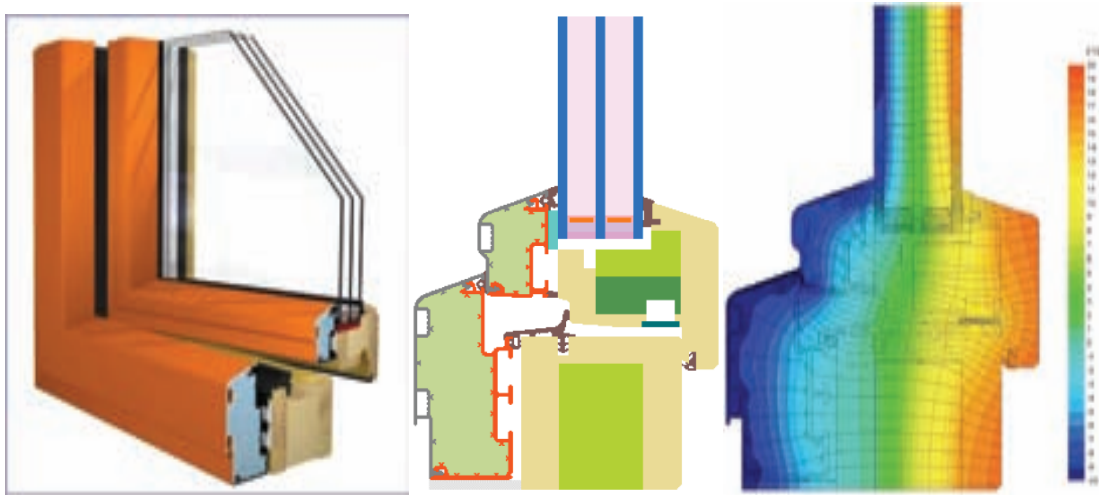


Figure 20. Example of a wood window frame with insulation filled Al cladding with low U-value - EGE-THERM PLUS by EGE Holzbau GmbH & Co. KG. One photo/drawing to the left, one schematic drawing in the middle and one temperature profile to the right. Wood frame with PUR, PUR recycled material and PUR filled Al cladding. Frame U-value $U_f = 0.77 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.ege.de.

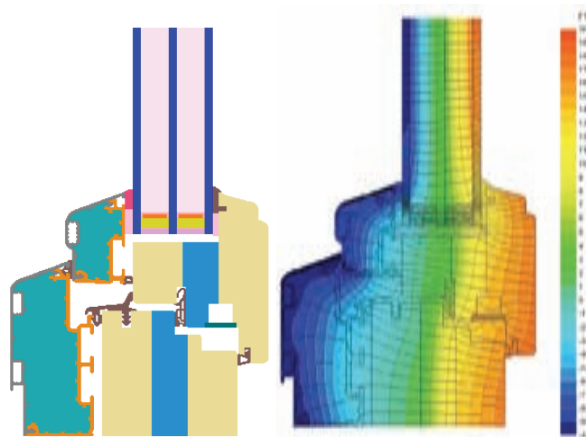


Figure 21. Example of a wood window frame with insulation filled Al cladding with low U-value - KombiRoyal Plus PH by NIVEAU Fenster Westerburg GmbH. One schematic drawing to the left and one temperature profile to the right. Wood frame with PUR and XPS filled Al cladding. Frame U-value $U_f = 0.68 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.niveau.de.

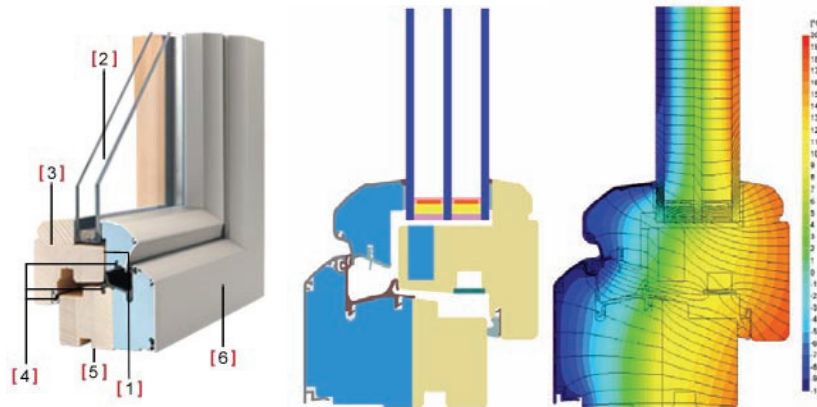


Figure 22. Example of a wood window frame with insulation filled Al cladding with low U-value - ed[it]ion passiv by Internorm International GmbH. One photo/drawing to the left, one schematic drawing in the middle and one temperature profile to the right. Wood frame with PUR and PUR filled Al cladding. Frame U-value $U_f = 0.73 \text{ W/m}^2\text{K}$. Compare with fixed window in Figure 27. From <http://www.passiv.de> and www.internorm.com.

5.1.3 PVC Frame

Examples of two PVC window frames are given in Figure 23-Figure 24, where further details may be found in appendix. In these two examples PUR is applied as a highly thermally insulating material inside the structural PVC frame construction. The placement of the PUR elements are varying from the frame edges to the middle of the frame.

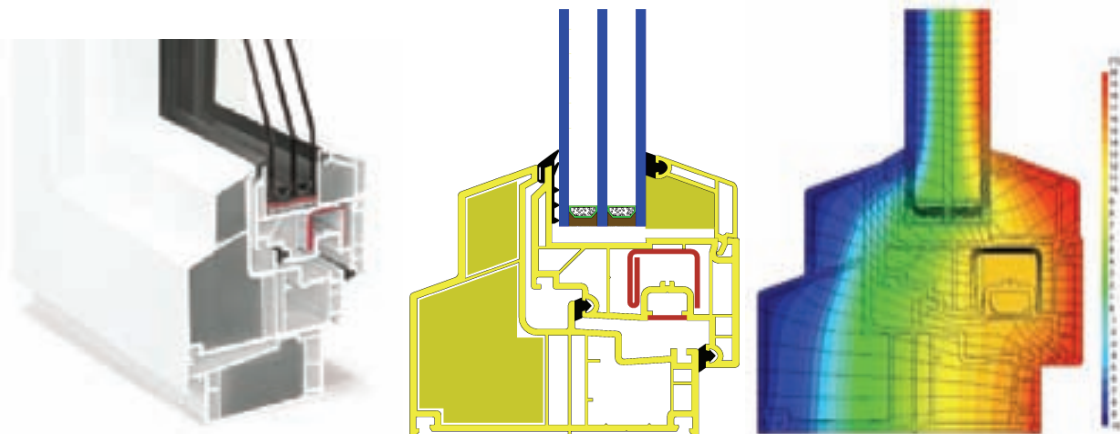


Figure 23. Example of a PVC window frame with low U-value - REHAU Clima Design by REHAU AG + Co, Hochbau. One photo/drawing to the left, one schematic drawing in the middle and one temperature profile to the right. PVC profile with PUR. Frame U-value $U_f = 0.71 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.rehau.de.

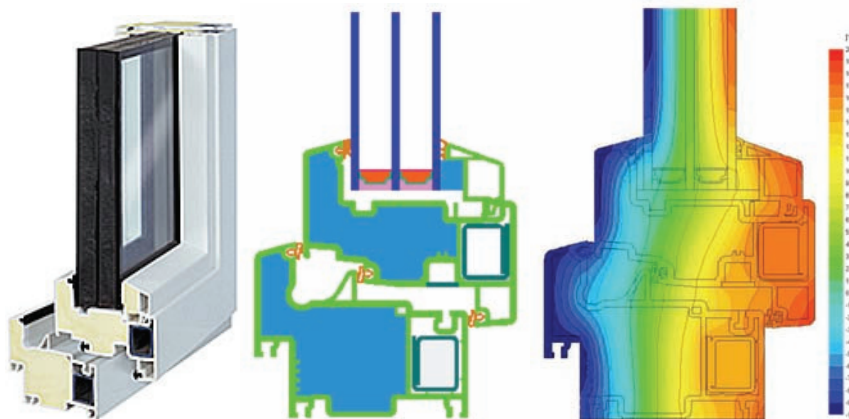


Figure 24. Example of a PVC window frame with low U-value - eCO₂ by Kochs GmbH. One photo/drawing to the left, one schematic drawing in the middle and one temperature profile to the right. PVC profile with PUR ($\lambda = 0.030 \text{ W/(mK)}$). Frame U-value $U_f = 0.74 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.kochs.de.

5.1.4 PVC Frame with Insulation Filled Al Cladding

Example of one PVC window frame with insulation filled Al cladding is given in Figure 25, where further details may be found in appendix. In this example PUR is applied as a highly thermally insulating material inside the Al cladding, while there is no insulation material inside the PVC frame.

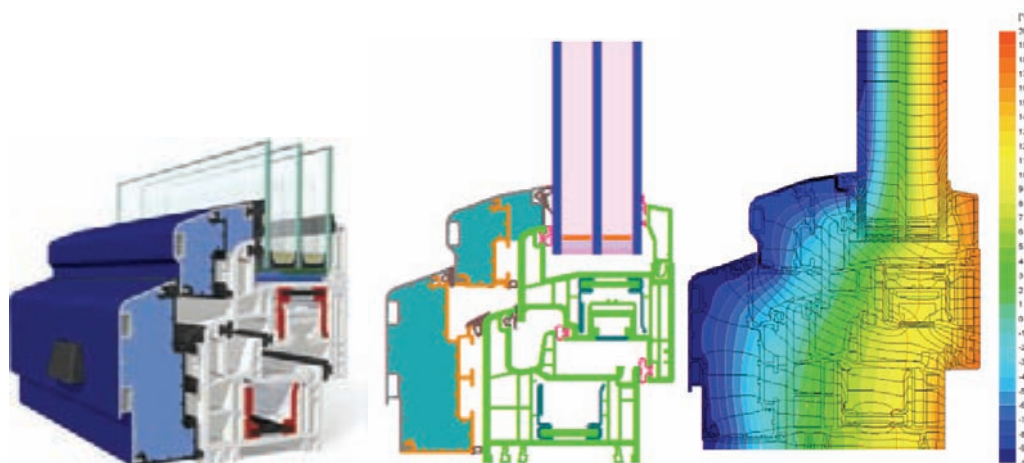


Figure 25. Example of a PVC window frame with insulation filled Al cladding with low U-value - GEALAN S 7000 IQ Passivhaus by GEALAN WERK Fickenscher GmbH. One drawing to the left, one schematic drawing in the middle and one temperature profile to the right. PUR filled Al cladding. Frame U-value $U_f = 0.82 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.gealan.de.

5.1.5 Al Frame

Example of one Al window frame is given in Figure 26, where further details may be found in appendix. In this example PUR is applied as a highly thermally insulating material inside the structural Al frame construction. The whole Al profile is filled with the PUR elements.

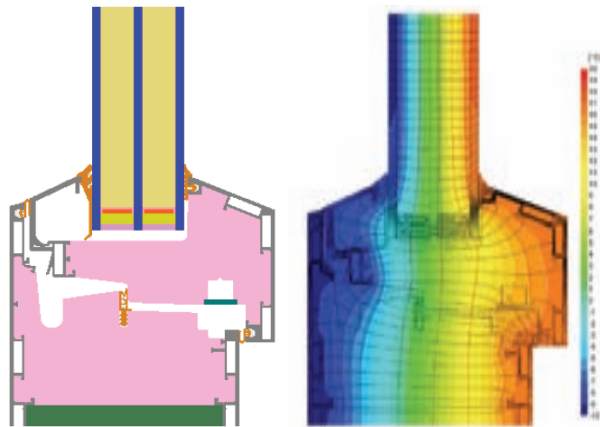


Figure 26. Example of an Al window frame with low U-value - RP-ISO-PURAL BP by Pural Profilwerk GmbH & Co. KG. One schematic drawing to the left and one temperature profile to the right. Al frame filled with PUR. Frame U-value $U_f = 0.71 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.pural-profile.de.

5.1.6 Fixed Wood and Al Frame

Example of one fixed wood and Al window frame is given in Figure 27, where further details may be found in appendix. In this example PUR is applied as a highly thermally insulating material inside the structural wood and Al frame construction. About half of the frame, towards the outer side, is filled with the PUR elements.

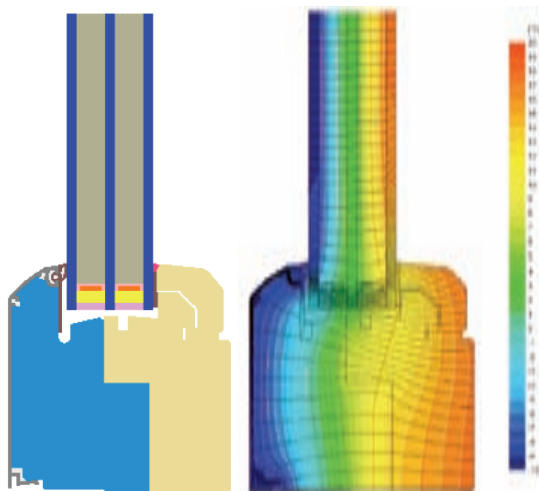


Figure 27. Example of a fixed wood and Al window frame with low U-value - ed[it]ion passiv, Fixverglasung by Internorm International GmbH. One schematic drawing to the left and one temperature profile to the right. Wood and Al frame filled with PUR. Frame U-value $U_f = 0.63 \text{ W/m}^2\text{K}$. Compare with opening window in Figure 22. From <http://www.passiv.de> and www.internorm.com.

5.1.7 Glass Facade System

Examples of two glass facade systems are given in Figure 28-Figure 29, where further details may be found in appendix.

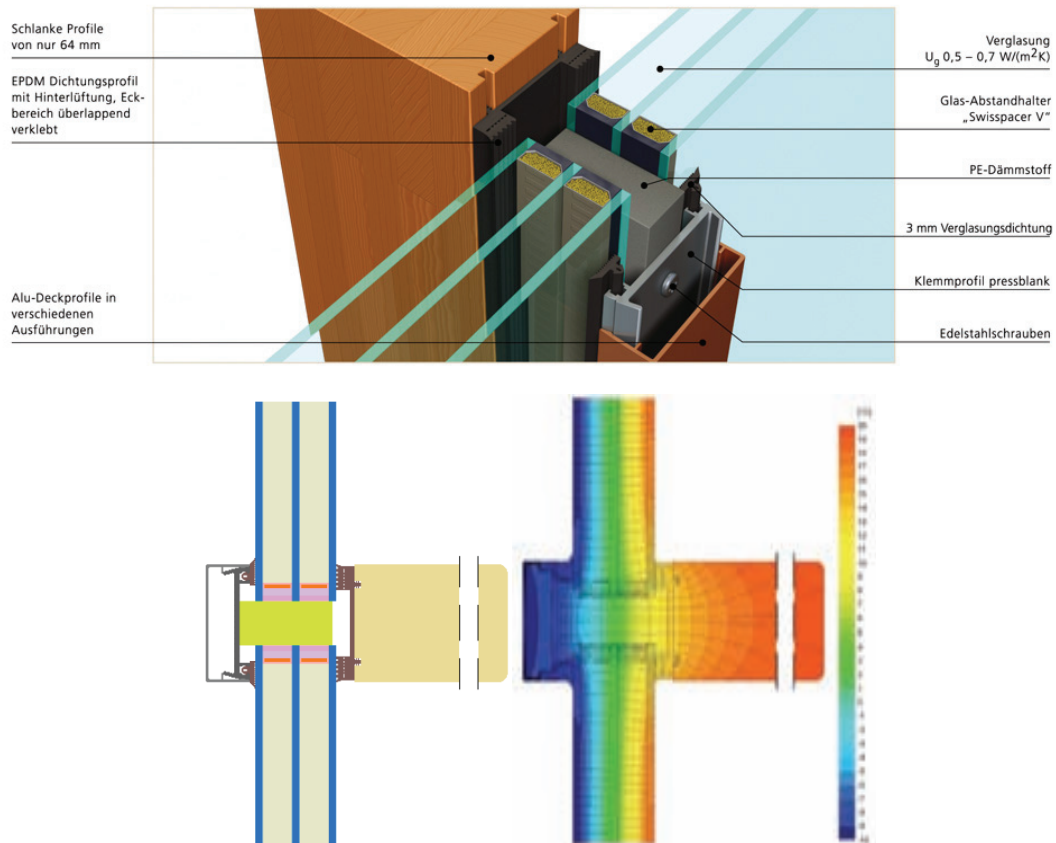


Figure 28. Example of a glass facade system with low U-value - ON TOP PLUS by Endl-Wagner GmbH. Picture on the top, one schematic drawing to the left and one temperature profile to the right. Wood-Al profile. Frame U-value $U_f = 0.65 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.endl.at.

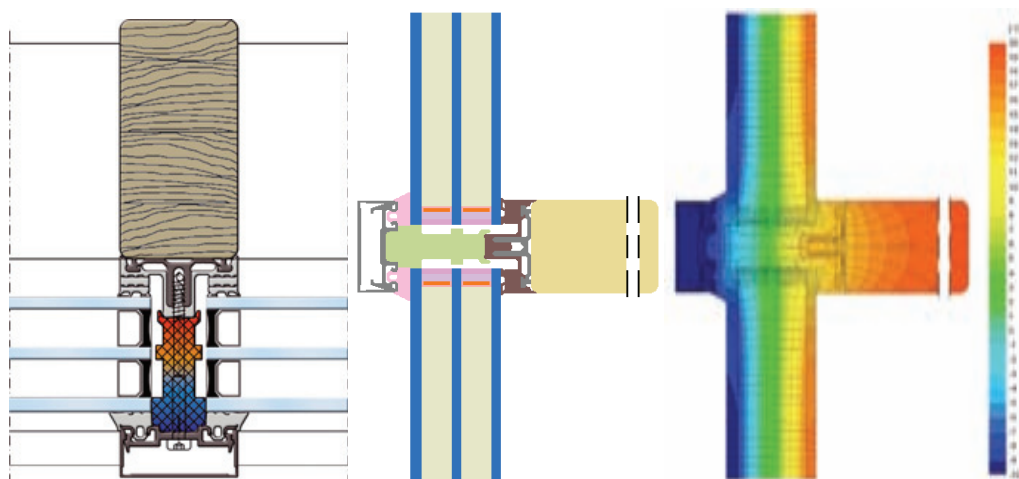


Figure 29. Example of a glass facade system with low U-value - FWT 50-1 HA E-plus by esco Metallbausysteme GmbH. Two schematic drawings to the left and in the middle, and one temperature profile to the right. Wood-Al profile. Frame U-value $U_f = 0.73 \text{ W/m}^2\text{K}$. From <http://www.passiv.de> and www.esco-online.de.

5.1.8 Window Frame Examples with Higher U-Values than the Passivhaus Requirement

Figure 30 shows a wood window with PUR and two layer window glazing from NorDan with a window U_w -value of $1.2 \text{ W/m}^2\text{K}$. Figure 31 shows a wood window (without any highly thermal insulation materials) and three layer window glazing from Elitfönster with a window U -value of $U_w = 0.9 \text{ W/m}^2\text{K}$. Figure 32 shows a fiberglass window from Thermotech with window U -values of $U_w = 1.0 \text{ W/m}^2\text{K}$ and $U_w = 1.6 \text{ W/m}^2\text{K}$ for a three-layer and two-layer window glazing, respectively. These window U -values are higher than the Passivhaus requirement of $U_w \leq 0.80 \text{ W/m}^2\text{K}$.

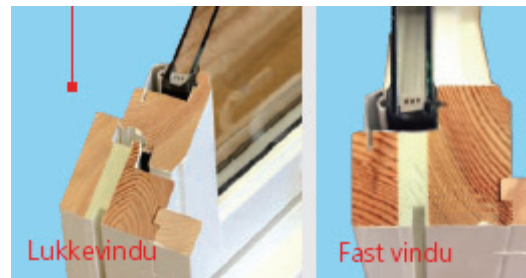


Figure 30. Example of a wood window frame with a relatively low U -value - N-Tech Lavenergi Superspacer by NorDan AS. Wood frame with PUR. The frame U -value is not stated, whereas the total window U -value is reported to be $U_w = 1.2 \text{ W/m}^2\text{K}$. Note that a two-layer window pane is employed in this case (not three-layer). From <http://www.nordan.no>.



Figure 31. Example of a wood window frame with a relatively low U -value - Elit Extreme 0,9 Fönster, AXH by Elitfönster AB. The frame U -value is not stated, whereas the total window U -value is reported to be $U_w = 0.9 \text{ W/m}^2\text{K}$. A three-layer window pane is employed in this case with a window glazing U -value of $U_g = 0.6 \text{ W/m}^2\text{K}$. From <http://www.elitfonster.se>.

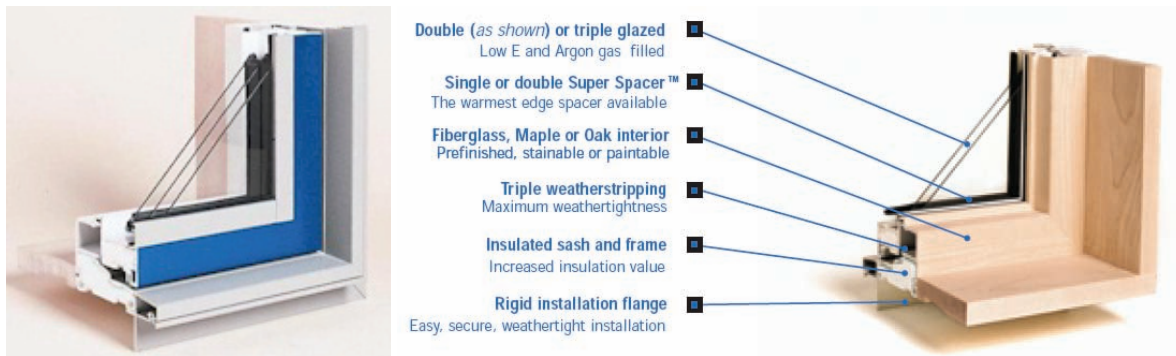


Figure 32. Example of a fiberglass window frame with a relatively low U -value - Thermotech windows by Thermotech Windows Ltd. The frame U -value is not stated, whereas one specific total window U -value is reported to be $U_w = 1.0 \text{ W/m}^2\text{K}$ with a window glazing U -value of $U_g = 0.7 \text{ W/m}^2\text{K}$ for a three-layer window pane (322 AFG TiR, #2,#5). The corresponding U -values for a two-layer window pane (211 AFG TiR, #3) system is $U_w = 1.6 \text{ W/(m}^2\text{K)}$ and $U_g = 1.4 \text{ W/m}^2\text{K}$. From <http://www.thermotechfiberglass.com>.

5.2 U-Value Comparison for Various Window Frame Types

An U_f -value comparison of the various window frame types are given in Table 3. The U -values (calculated according to the procedures in ISO 10077-2, with an isolation panel instead of the actual glazing) are examples and are not meant to be representative values for the different frame categories. From Table 3 it is seen that a specific wood frame (opening window) has a low frame U_f -value of $0.65 \text{ W/m}^2\text{K}$, whereas a fixed wood and Al frame has as low U_f -value as $0.63 \text{ W/m}^2\text{K}$. Note also that the PVC frame with insulation filled Al cladding has a frame U_f -value of $0.82 \text{ W/m}^2\text{K}$, and may still fulfill the Passivhaus requirements of a window U_w -value $\leq 0.80 \text{ W/m}^2\text{K}$ provided that the window glazing U -value is less than $0.80 \text{ W/m}^2\text{K}$. For this specific PVC frame (Figure 25) the window U_w -value = $0.80 \text{ W/m}^2\text{K}$ and glazing U_g -value = $0.70 \text{ W/m}^2\text{K}$.

With window glazing U_g -values as low as $0.7 \text{ W/m}^2\text{K}$ and even $0.5 \text{ W/m}^2\text{K}$ (triple glass, two low emissivity coatings, argon and krypton filled cavities, respectively), it is seen that the frame U_f -value is becoming the minimum factor.








5.3 Materials Applied in Window Frames

Table 4 gives the thermal conductivity for various window frame materials. Other properties, e.g. mechanical properties like the tensile strength, elasticity modulus and as impact hardness, are also important when materials are selected. Some materials which may be the best ones with respect to obtaining a very low thermal conductivity, exhibit usually not the required mechanical strength. In addition, other properties than the mechanical and thermal properties will also be important, e.g.

durability and climate exposure resistance are of outmost importance. Waste treatment, recycling and environmental impact of the various frame materials should also be considered.

Some materials may also represent a health hazard even if they are safe in their intended use. Polyurethane (PUR) is an example of this. During a fire PUR will when burning release hydrogen cyanide (HCN), which is very poisonous. The toxicity stems from the cyanide anion (CN⁻) which prevents cellular respiration. Generally, hydrogen cyanide may be found in the smoke from nitrogen (N) containing plastics. From the frame table in appendix, it is observed that PUR is definitively the most widespread applied highly thermal insulating material in the various window frames. This fact may be doubtful with respect to the above discussion concerning HCN poisonous release during a fire. Note that some low-conducting polymer foams like polyethylene (PE) and polypropylene (PP) with no additives do only contain carbon and hydrogen, and will therefore release only CO₂ (and maybe some CO) during a fire, i.e. no nitrogen or chlorine compounds. PE and PP foams may therefore represent possible substitutes for todays large use of PUR in highly insulating window frames. Advantages and disadvantages of using various structural window materials may be found at <http://www.greenspec.co.uk/html/materials/windowframes.html>, where the pro and cons do not necessarily present the whole and fully truth, but rather a specific point of view.

Table 3. Window frame types with examples of their corresponding U_F-values*.

Window Frame Type	Schematic Drawing	Thermal Insulation Fill Material	Figure Reference	U _F -value* (W/m ² K)
Wood frame		PUR	Figure 17	0.65
Wood frame with insulation filled Al cladding		PUR and XPS	Figure 21	0.68
PVC frame		PUR	Figure 23	0.71
PVC frame with insulation filled Al cladding		PUR	Figure 25	0.82
Al frame		PUR	Figure 26	0.71
Fixed wood and Al frame		PUR	Figure 27	0.63
Glass facade system		PE and EPDM (support)	Figure 28	0.65

*³⁾ U_F-values are calculated according to the procedures in ISO 10077-2, with an isolation panel instead of the actual glazing system.

Table 4. Thermal conductivity values for various window frame materials. Note that the tabulated values are from specific sources and that variations exist. Specific correct values need to be determined for each product and from each producer. Naturally, the thermal properties are influenced by the mass density of each material.

Window Frame Materials	Thermal Conductivity (W/mK)	References
Highly Thermal Insulating Materials		
Polyurethane (PUR) foam	0.021-0.050	1, 2, 3, 4, 5
Polyurethane (PUR) recycled material (e.g. Purenit)	0.06-0.1	2
Polyethylene (PE) foam	0.034-0.067	5, 6, 7, 8, 9
Polypropylene (PP) foam	0.034-0.067	9
Polyvinylchloride (PVC) foam	0.035	4
Polyetherimide (PEI) foam	0.025	9
Polystyrene (PS) foam (e.g. extruded/expanded, XPS/EPS)	0.027-0.057	3, 4, 9
Fiberglass matting	0.033-0.044	3
Cork	0.039-0.052	3, 5
Materials Utilized Partly as Thermal Insulation and Various Joint Materials		
Polyethylene (PE) (in glass facade systems) (HDPE)	0.33-0.50	10
Ethylene-propylene-diene-monomer (EPDM) rubber	0.25	10
Polyamide (Nylon)	0.25-0.30	10
Common Structural Frame Materials		
Wood (pine/spruce)	0.11-0.17	11
Aluminium alloy 6061 (Al)	160	10
Polyvinylchloride (PVC)	0.17	4, 10
Fiberglass composite	0.30	13
Wood composite material (e.g. Fibrex)	0.22	12
Glass	1.00	10

- 1) http://www.puren.eu/industry-products/puren_industry.pdf (valid: 2007-10-15)
- 2) <http://www.puren.eu/industry-products/purenit/purenit.pdf> (valid: 2007-10-15)
- 3) <http://www.fao.org/docrep/006/y5013e/y5013e08.htm> (valid: 2007-10-15)
- 4) http://www.learn.londonmet.ac.uk/packages/clear/thermal/buildings/building_fabric/properties/conductivity.html (valid: 2007-10-15)
- 5) <http://www.glacierbay.com/Heatprop.asp> (valid: 2007-10-15)
- 6) http://www.foamsearch.com/foam_types/polyethylene_foam.htm (valid: 2007-10-15)
- 7) <http://www.arnonplast.com/PE-Data/PE-Com-Sheet/ARNON-PE-CompareSheet.htm> (valid: 2007-10-15)
- 8) <http://www.arnonplast.com/PE-Data/PE-Com-Sheet/Comparison-PE&FG.pdf> (valid: 2007-10-15)
- 9) <http://www.specialchem4polymers.com/resources/articles/printarticle.aspx?id=868> (valid: 2007-10-15)
- 10) EN 12524:2000. Building materials and products. Hygrothermal properties. Tabulated design values
- 11) <http://www.fpl.fs.fed.us/documnts/fplgtr/fplgtr113/ch03.pdf> (valid: 2007-10-15)
- 12) <http://www.renewalbyandersen.com/servlet/Satellite/Renewal/Page/RbAStdLayout/1164649805005> (valid: 2007-10-15)
- 13) NFRC 101-2006 Procedure for Determining Thermophysical Properties of Materials For Use in NFRC-Approved Software Programs

As a digression it may be mentioned that in February 2007 NORDAM announced that they would use composite materials to build window frames for the Boing 787 Dreamliner (NORDAM, 2007). NORDAM will use HexMC®, which is a high performance carbon molding composite, specifically designed for compression molding. The epoxy matrix and high carbon fiber volume content enable components to be molded for a wide range of applications (HEXCEL, 2007). The thermal properties of the window, window frame or materials applied were not noted. Use of such materials in high performance window frames for buildings have however not been found.

5.4 Spacers

5.4.1 Spacers in General

Spacers for application in window panes represent an important component in the overall window design with respect to thermal properties. As this report focuses on window *frames*, spacers will not be dealt with exclusively in detail here. Some examples will be shown, though.

Shortly, as an excerpt from the table of frames in appendix concerning spacers, it is found that the spacers applied in these window panes in order to achieve/satisfy the PassivHaus window requirement is mainly one of the following two types:

- Swisspacer
- Thermix

or different variations of one of these two, e.g. Swisspacer V, Swisspacer with Al foil, Thermix TX.N, etc. In addition, some other spacers are also used:

- Refined/stainless steel
- TGI
- TPS

Refined or stainless steel is used as spacer bars in windows because it has a lower conductivity than the more common material aluminum. Stainless steel has a conductivity of about 17 W/mK while aluminum has a conductivity of about 200 W/mK. TGI-spacers are manufactured of stainless steel combined with a high quality plastic polypropylene as a strengthening and insulating material due to its low heat conductivity (<http://www.glassinsulation.de/english/products.cfm>). TPS stands for Thermo Plastic Spacer system, and is a butyl-based sealant, in an insulated glass unit. More details about Swisspacer and Thermix are given below.

5.4.2 Swisspacer

From the website <http://www.designbuild-network.com/contractors/joinery/giesbrecht/> the following excerpt concerning Swisspacer is made (see also Table 5):

“Swisspacer is a thermally-improved, or warm-edge, spacer bar for insulating glazing. It is manufactured from special fibreglass, composite material. Swisspacer is available in two versions:

- *Swisspacer - the composite material is covered by an ultra thin foil of aluminium*
- *Swisspacer V - with an extremely thin stainless steel foil for maximal possible insulation.*

These metallic foils guarantee the gas tightness and excellent sealant adhesion.”

Table 5. Thermal performance data^{†)} for Swisspacer. From the website <http://www.designbuild-network.com/contractors/joinery/giesbrecht/>.

Spacer system	Aluminum	High grade steel	Swisspacer	Swisspacer V
Wood window – Frame U-value $U_f = 1.3 \text{ W/m}^2\text{K}$ e.g.				
Ψ (W/mK) *)	0.074	0.053	0.044	0.033
Window U-value, U_w , 1-wing (W/m ² K)	1.3	1.3	1.3	1.2
Window U-value, U_w , 2-wing (W/m ² K)	1.5	1.4	1.3	1.3
Min glass surface temp. at -10, +20 (°C)	5.3	7.4	8.0	9.2
PVC window – Frame U-value $U_f = 1.9 \text{ W/m}^2\text{K}$ e.g				
Ψ (W/mK)	0.070	0.052	0.043	0.034
Window U-value, U_w , 1-wing (W/m ² K)	1.5	1.5	1.4	1.4
Window U-value, U_w , 2-wing (W/m ² K)	1.7	1.6	1.6	1.5
Min glass surface temp. at -10, +20 (°C)	6.8	8.6	9.2	10.1
Aluminum window – Frame U-value $U_f = 2.0 \text{ W/m}^2\text{K}$ e.g				
Ψ (W/mK)	0.115	0.072	0.060	0.041
Window U-value, U_w , 1-wing (W/m ² K)	1.7	1.6	1.5	1.5
Window U-value, U_w , 2-wing (W/m ² K)	1.9	1.7	1.7	1.6
Min glass surface temp. at -10, +20 (°C)	6.5	8.9	9.5	10.7

*) Ψ is the linear thermal transmittance at the glass edge (W/mK) according to EN ISO 10077-2.

†) All window U-values are based on a window area of 1.23 m x 1.48 m and glazing U-value of 1.1 W/m²K.

Furthermore, some additional information is given about Swisspacer and comparisons with other spacer materials in Figure 33 and Figure 34. Note the large thermal conductivity difference between Swisspacer (0.19 W/mK) and for example aluminum (200 W/mK).

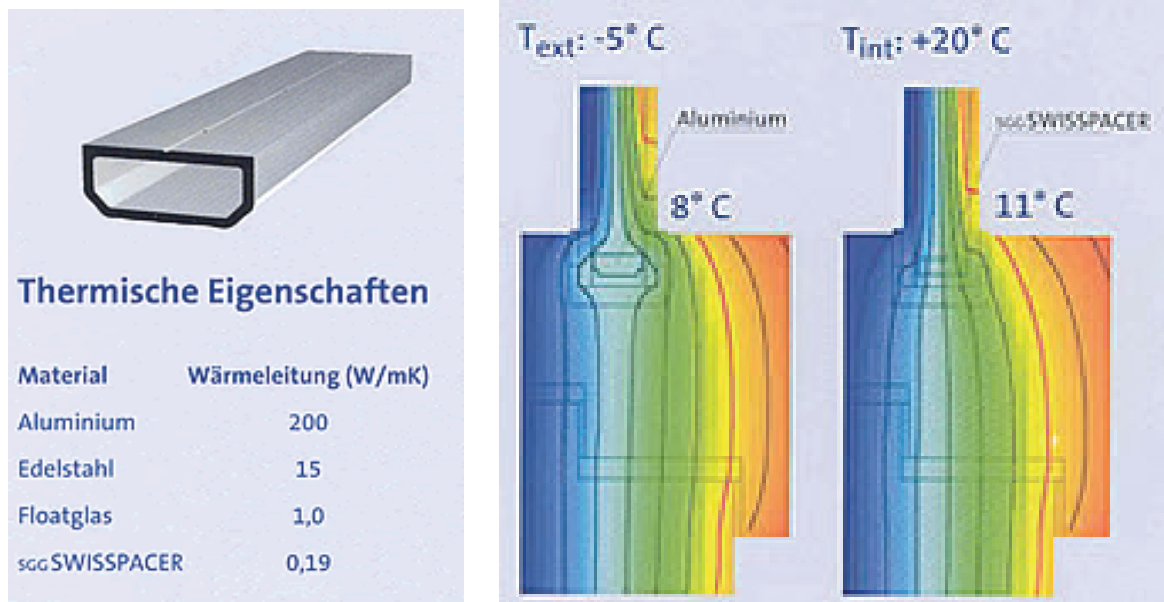


Figure 33. Selected Swisspacer information comparing thermal conductivity values with other materials (left) and temperature distribution in frame and lower glazing for Al and Swisspacer (right). From <http://www.pewo-fenster.ch/isolierglas.htm>.

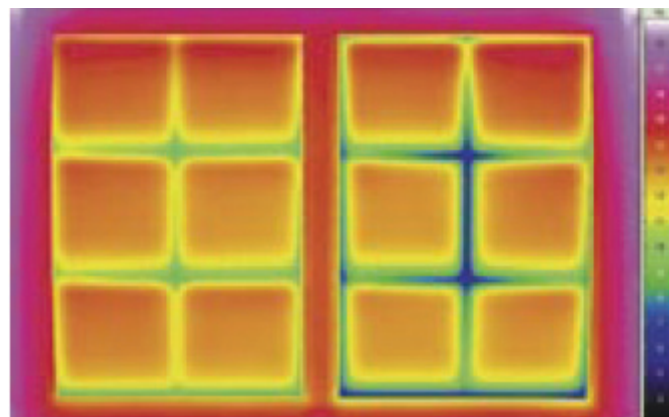


Figure 34. Infrared photo of two windows with Swisspacer to the left and normal Al profile to the right. From www.scanglas.dk/servlet/RichTextHandler?name=swisspacer.pdf.

5.4.3 Thermix

From the website <http://www.das-passivhaus.de/gb-fenster.html> the following excerpt concerning the Thermix spacer is made:

"More intelligently is the "Thermix"-sealant, constructed from PVC and high grade steel: High grade steel has a conduction rate of only 26 W/mK and the used PVC a rate of just 0.21 W/mK."

Furthermore, from <http://www.thermix.de/t-en/presse/2005/messe-bau-intelligenter-isolieren.php>:

"Thermix® bars are made of glass-fibre reinforced plastics. The water vapour and gas tightness of the Thermix® edge bond has been demonstrated on the basis of valid norms."

Miscellaneous information about the Thermix spacer and comparisons with other spacer materials are given in Table 6 and in Figure 35 and Figure 36.

Table 6. Comparison of Thermix TX.N (noted as Thermix in the table below) with Al spacers^{*)}. From the website http://www.insulbar.de/i-it/pdf/Thermix_TXN_flyer_E_0307.pdf.

Type of window	Wood window		Plastic window		Thermally broken metal window	
Glazing U_g (W/m ² K)	1.2		1.2		1.2	
Frame U_f (W/m ² K)	1.4		1.9		2.0	
Spacer	Aluminum	Thermix	Aluminum	Thermix	Aluminum	Thermix
Ψ -value (W/mK)	0.08	0.040	0.08	0.036	0.11	0.053
Improvement in Ψ by Thermix (%)	50		55		52	
Window U_w (W/m ² K)	1.46	1.36	1.61	1.50	1.72	1.57

^{*)} Values for aluminum spacers are from prEN ISO 10077-1:2004/8.



Figure 35. Drawings of the Thermix spacer. From the website <http://www.ensinger-online.com/prospekte/pdfdownload.php?ID=54>.



Figure 36. Thermix TX.N spacer. From <http://www.fenestration-uk.com/News/NewsItemRSS.aspx?id=1885>.

6 Discussion

When future window frames are going to be developed and future window frame research is to be carried out, it is necessary to know what the current status is. This report makes an attempt to establish this. At the same time it is also important to know what the aims of the research and product development should be, and what criteria should be used to evaluate the window and the frame. In this chapter a summary of the state of the art is presented in Chapters 6.2 and 6.3, with a discussion about the future development aims found in Chapter 6.4. Chapter 6.1 discusses briefly the frame rating procedures.

6.1 Frame Thermal Performance Rating

In Chapter 2, two different window rating procedures have been pointed out, the *U-factor* and the *Net Energy Gain*. For heating dominated climates the latter may be to be the way to go, although very different windows may be the optimum solution for different buildings (dwellings, office buildings, factories etc.). It might therefore be “dangerous” or misleading to look at one parameter, being either the *Net Energy Gain* or the U-value, for selecting windows. What is wanted is an optimum indoor climate for the users of the building. A window that has optimum properties for capturing energy might not be optimum with respect to giving satisfactory temperature, light and glare conditions for the users of the buildings. A window that works very well during winter conditions may make the building uninhabitable in the summer season. It is therefore recommended that whole building energy simulation programs are used to assess the indoor climate of the building. Several windows configurations (e.g. thermal properties including shading, window areas, and façade distribution) may be considered.

Still, when rating individual building components like walls, windows and doors, simple parameters may be wanted. In national codes, for instance, the U-value is the parameter that attracts the most attention, for all kinds of building elements. For opaque building sections like walls and window frames the U-value might also be the most appropriate parameter. But, for windows with a solar-energy transparent glazing, what really is of interest is the right combination of parameters, e.g. light transmittance, solar or near infrared reflectance, U- and g-value, for the building in question, i.e. building type and climate. A window’s solar transmittance and reflectance properties may be divided into several parameters depending on the part of the solar spectrum of interest (i.e. ultraviolet, visible and near infrared radiation). For one building one type of window (frame, glazing and shading accessories) might be the right choice, but for another building a different window might be the appropriate one.

For the frame alone the U-value seems to be the right parameter if individual frames are being compared.

6.2 Heat Transfer Modeling

Based on the literature review the following summary related to heat transfer modeling of window frames may be presented. This summary relates mostly to the standard ISO 15099. This standard seems to be the most up to date and accurate standard, e.g. the standard differentiates between vertical and horizontal frames. The standard also refers to scientific reports and papers where it prescribes certain procedures or correlations.

- Conduction in solid materials can be accurately modeled with most simulation codes, provided that an appropriate mesh is used for the geometry in question, although it may be questioned whether today's treatment of hardware penetrating parts of the frame (i.e. hinge) is sufficiently accurately treated. Hardware effects will be more important for high-performance frames than for frames with a high U-value.
- International standards prescribe that natural convection correlations shall be used for air cavities in window frames. For horizontal frames (sill and head) the correlations in ISO 15099 are not necessarily accurate for vertical aspect ratios between 0.5 and 5, because they are based on interpolation between other correlations. The frame cavity correlations supposed to be used in vertical frame cavities according to ISO 15099 are developed for glazing cavities. Correlations for vertical jambs exist; see Gustavsen and Thue (2007). Fomichev et al. 2007 has recently also developed correlations for tilted frame cavities, both for horizontal (sill, head sections) and vertical frame (jamb) sections. These new correlations might be more accurate than the currently used correlations.
- Frame cavities should be divided for interconnections smaller than 7 mm; ISO 15099 sets the break point at 5 mm. Division of frame cavities should also be considered for cavities having sharp angles, because little convection takes place there.
- According to ISO 15099 a radiation correlation is used to account for frame cavity radiation heat transfer. Research has shown that using a view-factor based method instead of this correlation improves the accuracy.
- There exist variable surface coefficient equations that can be used to resemble the heat transfer effects at the frame surfaces (i.e. in corners).
- CFD simulation of heat transfer in window frames (with and without frame cavities), has shown that CFD tools can be used to predict the thermal transmittance and surface temperature with good accuracy.

The summary shows that there is still room for improvement in the international standards used for calculation of the thermal performance for window frames. Some of the improvement can easily be incorporated because new correlations and calculation procedure already exists (i.e. improved radiation modeling). Within other areas, more research is needed to improve the calculation procedures.

A question that may be raised is; why not use CFD tools instead of conduction tools and natural convection correlations to capture the convection effects that occur at external and internal surfaces and in frame cavities? With CFD tools heat transfer at the internal and external surfaces and in the cavities will be a part of the solution process. Before a decision about moving to CFD can be made, one should be aware of that vertical window frames (jambs) require three-dimensional geometries to be simulated in order to reproduce the convection effects taking place. Therefore it seems like user friendly three-dimensional conduction calculation tools (with correlations for natural convection) should be the first target. When these are available, one may consider including fluid flow equations.

CFD simulations will take more time to do than conduction simulations. There are two reasons for this: 1) there are more equations to solve for CFD problems, and 2) simulating vertical sections require three-dimensional geometries to be simulated. If practitioners should move to CFD, the added simulation time should not be very large, especially taking into account that many frame designers simulate many frame geometries to find the one with the best thermal performance.

One problem that may arise when solving the full CFD problem of heat transfer in window frames and windows in general, is that some cases do not necessarily have a stationary solution. Procedures for how to find and report the thermal transmittance (which is a stationary quantity) will then be needed.

6.3 Frame Materials and Design

Based on the literature and market review in Chapters 4 and 5, it seems like there exists two different tracks for finding better windows and window frames in particular:

1. Based on the current typical frame geometry (frame with a height of typically 10 cm), reduce the U-value as much as possible. The various strategies may then be sought:
 - a. *New Materials*. Apply or invent new novel thermally low conducting materials which satisfy the requirements for being used in window frames.
 - b. *New Constructions/Solutions*. Apply or invent new novel thermally low conducting constructions/solutions which satisfy the requirements for being used in window frames.
 - c. *Substitution Strategy*. Substitute large parts of the existing window frame with known thermally low conducting materials, which alone can not constitute the whole frame (due to mechanical strength, stability etc.), e.g. polyurethane (PU) in a wood frame.

2. Develop new window designs where the main aim is to make windows with a very slim frame, or no frame at all.

The first point seems to be a result of the focus on the U-value (transmission losses) by itself. Then the aim is to have a window with a low U-value, and since the frame is an important part of a window, the frame U-value should be minimized. The size of the frame is not that important, as long as the frame U-value is lower than the glazing U-value (which usually not is the case today).

The second item is a result of using the *Net Energy Gain* (see Chapter 2) to rate windows. Then the (solar) energy gain through windows also plays an important part, in addition to the transmission losses. The focus is at maximizing the energy gain through the window (at least when only the heating season is considered). This again leads to maximizing the glazing area (in addition to increasing the g-value and reducing the U-value), which again results in slim frame profiles. Ultimately, the best window frame might be no frame at all.

The market review seems to depict that the substitution strategy is the most applied one so far.

As seen in earlier chapters and in the table in appendix, polyurethane (PUR) is clearly the most widespread applied highly thermal insulating material in the PassivHaus window frames, e.g. within wood frames. Certain variations of the PUR material (foam etc.) have very low thermal conductivities, e.g. 0.023 W/mK. This widespread use of PUR may give rise to a concern as when PUR is burning during a fire, hydrogen cyanide (HCN), which is very poisonous, will be released. A search for other highly thermal insulating frame materials, which are at least as good as PUR for frame applications, especially with respect to thermal properties, may/will therefore be important.

The following options should be explored in order to improve the thermal performance of frames even more:

- The slim wood frame suggested by Lautsen and Svendsen (2005) may be improved by replacing some of the wood in the frame with thermal insulation materials. Then the slim frame is retained (allowing a high net energy gain) but with a frame that has a lower U-value.
- New insulation materials should be investigated, aiming at finding the best thermal insulating materials suitable for application in window frames.
- Development or invention of new novel thermally low-conducting frame constructions/solutions might also be a possibility.

6.4 Window Frame Research and Development Aims

The thermal performance of the window frame has undoubtedly an effect on the thermal performance of the entire window, because the U-value of the entire window is an area-weighted average of the individual components (glazing, edge and frame). Therefore, a frame with a lower U-value than the glazing will have a good effect on the total window U-value, and vice versa. When the thermal performance of the glazing is improving, it will therefore also be important to have window frames that can match or be better than the U-value of the glazing. If this becomes a problem, the focus will be on reducing the frame area.

So far the best available glazing systems have a U_g -value of about $0.5 \text{ W/m}^2\text{K}$ (3 panes of glass with 2 layers of low emissivity coatings and krypton filling). A design target for frames therefore seems to be a U_f -value of about $0.5 \text{ W/m}^2\text{K}$ or better. On the other hand, if window frames are compared to other opaque building elements, like walls, one should look at the code requirements. In Norway for instance, the current U-value requirement for walls is $0.18 \text{ W/m}^2\text{K}$. Other countries have similar requirements. Using other parameters than the U-value (i.e. net energy gain, or performing whole building simulations) to find a performance target may lead to other research and development aims. Both Nielsen et al. (2000) and Arasteh et al. (2007) have shown that windows with a U_w -value larger or equal to about $1.0 \text{ W/m}^2\text{K}$ can provide a net energy gain to a building, while a window with a lower U_w -value may not. This depends on the window properties and the climate (outdoor temperature and solar radiation).

One window may be optimized either with summer or winter conditions in mind, or by doing a whole year energy simulation. *The optimum building is a building in which a heating system and a cooling system is redundant.* With respect to this, *a good window* will help a building designer in building such a building. Thus, an optimum window is a window that minimizes the need for a heating (it should have small transmission losses and admit heat into the building when needed) and a cooling system (it keeps solar radiation out of the building, or lets heat out, when needed). A good window also minimizes the need for artificial lighting. Since, for most climates, the need for heating and cooling varies during the year the window needs to be dynamic.

So far only the glazing part of a window has been considered dynamic. It is through this part of the window that heat can enter directly into the building (and be blocked if necessary). The frame on the other hand stops the sunlight from entering the building. For the frame this leads to the following conclusions: Either the frame has to be reduced to a minimum, allowing a maximum controllable glazing area. Or the frame itself has to have dynamic properties that can be utilized to fulfill the goal of a building with no heating or cooling system.

The authors of this report see the following potential technological applications for the frame, involving dynamic utilization of the frame:

- Include phase change materials in the frame, e.g. to store heat until it is needed (although such materials may be better utilized when used inside the building).
- Integrate a shading system with the frame and glazing in a way that also makes it usable for additional night time insulation (external or integrated in the glazing). Sufficient air tightness for the additional air or gas layer(s) is important to make this work.
- PV cells may be integrated in the frames; whereas due to visual considerations, there may be limitations in integrating PV cells in the glazing.
- The frame may be used for storage of smart controlling equipment for shading systems (e.g. external blinds or electrochromics). It should be possible to buy self-contained (wireless, if necessary) units, with electronic components having the same life time as the hardware (insulated glazing unit and frame) of the window itself. Electrochromic windows (ECWs) will be powered from the electrical grid system in buildings, where the solar energy transfer in the ECWs may be controlled automatically by the computer system in an intelligent building system. The automatic control system may receive input from a temperature sensor inside the building and a light sensor outside the building. A manual override system located on the windows themselves may also be desirable from a user's point of view.

7 Conclusions

This report shows that there exist several alternatives to traditional wood, PVC and aluminum window frames. Most of the high performance frames found in this study have a U_f -value of about 0.7-0.8 W/m^2K . The lowest U_f -value found is 0.63 W/m^2K (for a traditional looking window frame). This frame consists of an inner layer of wood, with an aluminum cladding and polyurethane in between. Still there is a discrepancy between the best standard glazings, having a U -value of 0.5 W/m^2K , and the best frame. And the difference is even larger between the thermal performance of typical walls (U -values of 0.2-0.3 W/m^2K) and window frames. It is therefore important to decrease the U -value of window frames even lower than the currently best frames.

This report also reports and discusses heat transfer modeling issues related to window frames. Thermal performance increasing measures, surface modeling, and frame cavity modeling are among the topics discussed. The review shows that the current knowledge gives the basis for improving the calculation standards' calculation procedures. At the same time it is room for improvement within some areas.

8 References

Arasteh, D., Goudey, H., Huang, J., Kohler, C. and Mitchell, R. 2007. Performance Criteria for Residential Zero Energy Windows, *ASHRAE Transactions*, Vol. 113, pt. 1, pp. 176-185.

Arasteh, D.K., Finlayson, E., Curcija, D., Baker, J., and Huizenga, C. 1998. Guidelines for modeling projecting fenestration products, *ASHRAE Transactions*, Vol. 104, pp. 856-860.

ASHRAE 1998. Standard Method for Determining and Expressing the Heat Transfer and Total Optical Properties of Fenestration Products, Public Review Draft of Standard 142P, American Society of Heating, Refrigerating and Air Conditioning Engineers, Atlanta.

Batchelor, G.K. 1954. Heat transfer by free convection across a closed cavity between vertical boundaries at different temperatures, *Quarterly Applied Mathematics*, Vol. 12, pp. 209-233.

Berkovsky, B.M. and V.K. Polevikov. 1977. Numerical study of problems on high-intensive free convection. In: *Heat Transfer and Turbulent Buoyant convection* (D.B. Spalding and N. Afgan, editors), Vol. II, pp. 443-455. Washington: Hemisphere Publishing Corporation.

Blanusa, P., Goss, W.P., Roth, H., Weitzmann, P., Jensen, C.F., Svendsen, S., and Elmahdy, H. 2007. Comparison between ASHRAE and ISO thermal transmittance calculation methods, *Energy and Buildings*, Vol. 39, pp. 374-384.

Blomberg, T. 2000. *HEAT2, A PC-program for heat transfer in two dimensions. Manual with brief theory and examples. Version 5.0.* Lund: Lund University.

Branchaud, T.R., D. Curcija, and W.P. Goss. 1998. Local heat transfer in open frame cavities of fenestration systems. In: *Thermal performance of the exterior envelopes of buildings*. Atlanta: American Society of Heating, Refrigeration and Air-Conditioning Engineers.

Byars, N. and Arasteh, D. 1992. Design options for low-conductivity window frames, *Solar Energy Materials and Solar Cells*, Vol. 25, pp. 143-148.

Carpenter, S.C. and Elmahdy, A.H. 1994. Thermal performance of complex fenestration systems, *ASHRAE Transactions*, Vol 100, pp. 1179-1186.

Carpenter, S. and Hanam, M. 2001. Rating the Condensation Potential of Windows: Results from Testing and Simulation, *ASHRAE Transactions*, Vol. 107, pp. 550-558.

Carpenter, S.C. and A.G. McGowan. 1989. Frame and spacer effects on window U-value. *ASHRAE Transactions*, Vol. 95, pp. 604-608.

Carpenter, S.C. and A. McGowan. 1998. Three-dimensional heat transfer effects in building components. *ASHRAE Transactions*, Vol. 104, pp. 1070-1076.

Curcija, D. 1992. *Three-dimensional finite elements model of overall, night time heat transfer through fenestration products*. Ph.D. dissertation. Massachusetts: Department of Mechanical and Industrial Engineering, University of Massachusetts Amherst.

Curcija, D. and W.P. Goss. 1993. Two-dimensional natural convection over the isothermal indoor fenestration surface - finite element numerical solution. *ASHRAE Transactions*, Vol. 99, pp. 274-287.

Curcija, D. and Goss, W.P. 1994. Two-dimensional finite-element model of heat transfer in complete fenestration systems, *ASHRAE Transaction*, Vol. 100, pp. 1207-1221.

- Eckert, E.R.G. and W.O. Carlson. 1961. Natural convection in an air layer enclosed between two vertical plates with different temperatures, *International Journal of Heat and Mass Transfer*, Vol. 2, pp. 106-120.
- Elmahdy, A.H. and Frank, T. 1993. Heat transfer at the edge of sealed insulating glass units: Comparison of hot bok measurements with finite-difference modeling, *ASHRAE Transactions*, Vol. 99, pp. 915-922.
- Elmahdy, A.H. 2003. Effects of improved spacer bar design on Window Performance, Construction Technology Update No. 58. Ottawa, Ontario: Institute for Research in Construction, National Research Council Canada. (<http://www.irc.nrc-cnrc.gc.ca>).
- ElSherbiny, S.M., G.D. Raithby, and K.G.T. Hollands. 1982a. Heat transfer by natural convection across vertical and inclined air layers. - *Journal of Heat Transfer. Transactions of the ASME*, Vol. 104, pp. 96-102.
- Encyclopædia Britannica. 2007. Window, Encyclopædia Britannica Online. 30 July 2007, <http://www.britannica.com/eb/article-9077176>.
- Enermodal 2001. *Modelling Windows, Glass Doors and Other Products with FRAMEplus 5*. Kitchener, Ontario: Enermodal Engineering.
- Erten, E., Kamuran, Ö. and Sümerkan, M.R. 1996. A locally developed reinforced mosaic door and window frame for the Black Sea region of Turkey. *Construction and Building Material*, Vol. 10, pp. 441-444.
- Fang, Y., Eames, P.C. 2006. The effect of glass coating emittance and frame rebate on heat transfer through vacuum and electrochromic vacuum glazed windows, *Solar Energy Materials & Solar Cells*, Vol. 90, pp. 2683–2695.
- Finlayson, E., R. Mitchell, D. Arasteh, C. Huizenga, and D. Curcija. 1998. THERM 2.0. Program description. A PC program for analyzing the two-dimensional heat transfer through building products. Berkeley: University of California.
- Fomichev, A., Curcija, D.C., Balagurunathan, B., and Stocki, M. 2007. *Investigation of heat transfer effects of sloped and ventilated internal cavities of framing systems, Final Report*. Amherst: Center for Energy Efficiency and Renewable Energy, University of Massachusetts.
- Griffith, B., Curcija, D., Türler, D., and Arasteh, D.K. 1998a. Improving computer simulations of heat transfer for projecting fenestration products: Using Radiation view-factor models, *ASHRAE Transactions*, Vol. 104, pp. 845-855.
- Griffith, B., E. Finlayson, M. Yazdanian, and D. Arasteh. 1998b. The Significance of bolts in the thermal performance of curtain-wall frames for glazed facades. *ASHRAE Transactions*, Vol. 104, pp. 1063-1069.
- Gustavsen, A. 2001. Heat transfer in window frames with internal cavities. PhD Thesis. Department of Building and Construction Engineering, Norwegian University of Science and Technology.
- Gustavsen A., Griffith B.T., and Arasteh D. 2001a. Natural convection effects in three-dimensional window frames with internal cavities, *ASHRAE Transactions*, Vol. 107, pp. 527-537.
- Gustavsen A., Griffith B.T., and Arasteh D. 2001b. Three-dimensional conjugate computational fluid dynamics simulations of internal window frame cavities validated using infrared thermography, *ASHRAE Transactions*, Vol. 107, pp. 538-549.

Gustavsen, A., Kohler, C., Arasteh, D., and Curcija, D. 2005. Two-Dimensional Conduction and CFD Simulations of Heat Transfer in Horizontal Window Frame Cavities. *ASHRAE transactions*, Vol. 111, pp. 587-598.

Gustavsen, A., Kohler, C., Arasteh, D., and Dalehaug, A. 2007. Two-dimensional computational fluid dynamics and conduction simulations of heat transfer in horizontal window frames with internal cavities, *ASHRAE Transactions*, Vol. 113, Pt. 1, pp. 165-175.

Gustavsen, A. and Thue, J.V. 2007. Numerical simulation of natural convection in three-dimensional cavities with a high vertical aspect ratio and a low horizontal aspect ratio, *Journal of Building Physics*, Vol. 30(3), pp. 217-240. (<http://dx.doi.org/10.1177/1744259107071660>.)

Hallé, S., M.A. Bernier, A. Patenaude, and R. Jutras. 1998. The combined effect of air leakage and conductive heat transfer in window frames and its impact on the Canadian energy rating procedure. *ASHRAE Transactions*, Vol. 104, pp. 176-184.

HEXCEL. 2007. HexMC - Sheet-molding compound, <http://www.hexcel.com/Products/Matrix+Products/Other+FRM/HexMC/>. (Link valid 2007-06-29).

Hollands, K.G.T., T.E. Unny, G.D. Raithby, and L. Konicek. 1976. Free convective heat transfer across inclined air layers. *Journal of Heat Transfer. Transactions of the ASME*, Vol. 98, pp. 189-193.

ISO 2003. ISO 10077-2, Thermal Performance of Windows, Doors and Shutters—Calculation of Thermal Transmittance—Part 2: Numerical Method for Frames, International Standards Organization, Geneva.

Jakubowicz, I. and Möller, K. 1992. An FTIR, impact strength and thermal analysis investigation of a PVC window frame naturally aged for 20 years, *Polymer Degradation and Stability*, Vol. 36, pp. 111-120.

Jonsson, B. 1985. *Heat transfer trough windows. During the hours of darkness with the effect of infiltration ignored*. Document D13:1985. Stockholm: Swedish Council for Building Research.

Kohler, C., Arasteh, D. Mitchell, R. 2003. THERM Simulations of Window Indoor Surface Temperatures for Predicting Condensation, *ASHRAE Transactions*, Vol. 109.

Korpela, S.A., Y. Lee, and J.E. Drummond 1982. Heat transfer through a double pane window, *Journal of Heat Transfer. Transactions of the ASME*, Vol. 104, pp. 539-544.

Lartigue, B., S. Lorente, and B. Bourret. 2000. Multicellular natural convection in a high aspect ratio cavity: experimental and numerical results, *International Journal of Heat and Mass Transfer*, Vol. 43, pp. 3157-3170.

Laustsen, J.B and Svendsen, S. 2005. Improved Windows for Cold Climates, *Proceedings of the 7th Nordic symposium on building physics*.

Lee, Y. and S.A. Korpela. 1983. Multicellular natural convection in a vertical slot. *Journal of Fluid Mechanics*, Vol. 126, pp. 91-121.

Löffler, M. 1997. Foamglass as spacer in multiple glazing. Detailed study for new design of edge seal in multiple-glazing significantly reduces energy consumption, *Building Research and Information*, Vol. 25, pp. 107-110.







- Löffler, M. and Buck, D. 1997. Glazing edge-seal using foamglass as spacer and frameless window design, *Solar Energy*, Vol. 61, 5, pp. 303-312.
- Mitchell, R., Huang, J., Arasteh, D., Huizenga, C., and Glendenning, S. 2005. RESFEN5: Program Description. A PC Program for Calculating the Heating and Cooling Energy Use of Windows in Residential Buildings, Lawrence Berkeley National Laboratory.
- Moshfegh, B., Loyd, D., and Karlsson, B. 1989. Heat Transfer at modern windows - Risk of condensation, *Energy and Buildings*, Vol. 13, pp.119-125.
- NBC 1969. *Norwegian building code* (in Norwegian). Forskrifter om bygg av 1. august 1969. Oslo: GRØNDAHL & SØN.
- NBC 1987. *Norwegian building code* (in Norwegian). Byggeforskrift av 27. mai 1987 nr. 458 med endringer, sist av 21. desember 1988 nr. 1144. Oslo: GRØNDAHL & SØN.
- NBC 1997. *Norwegian building code* (in Norwegian). Forskrift om krav til byggverk og produkter til byggverk. Tekniske forskrifter til plan- og bygningsloven av 14. juni 1985 nr.77. Oslo: Statens byggetekniske etat.
- NBC 2007. *Norwegian building code* (in Norwegian). Forskrift om endringer i forskrift 22.1.1997 nr. 33 til plan- og bygningsloven om krav til byggverk og produkter til byggverk (TEK). Oslo: Statens byggetekniske etat.
- Nielsen, T.R., Duer, K., and Svendsen, S. 2000. Energy performance of glazings and windows, *Solar Energy*, Vol. 69, pp. 137–143.
- NORDAM 2007. NORDAM pioneers composite window frames for Boeing 787 Dreamliner, http://www.nordam.com/news/press_releases/default.aspx?pr=020807-1. (Link valid 2007-06-29).
- Noyé, P., Laustsen, J.B. and Svendsen, S. 2002. Windows with improved energy performance, *Proceedings of the 6th Nordic Symposium on Building Physics*.
- Noyé, P.A., Laustsen, J.B. Svendsen, S. 2004. Calculating the heat transfer coefficient of frame profiles with internal cavities, *Nordic Journal of Building Physics (Acta physica aedificiorum)*, Vol. 3, <http://www.byv.kth.se/avd/byte/bphys/>.
- Raithby, G.D., K.G.T. Hollands and T.E. Unny. 1977. Analysis of heat transfer by natural convection across vertical fluid layers. *Journal of Heat Transfer. Transactions of the ASME*, Vol. 99, pp. 287-293.
- Schrey, A.-C., R.A. Fraser, and P.F. de Abreu. 1998. Local heat transfer coefficients for a flushmounted glazing unit. *ASHRAE Transactions*, Vol. 104, pp. 1207-1221.
- Shewen, E., K.G.T. Hollands, and G.D. Raithby. 1996. Heat transfer by natural convection across a vertical air cavity of large aspect ratio. *Journal of Heat Transfer. Transactions of the ASME*, Vol. 118, pp. 993-995.
- Schultz, J. M., and Svendsen, S. 2000. Improved energy performance of windows through an optimization of the combined effect of solar gain and heat loss. In: *Proceedings of the EuroSun 2000*, Copenhagen, Denmark, June 19–22, 2000.
- Schultz, J.M. 2002. *Windows with a slim frame construction and a large light and solar transmission* (in Danish), Report R-028, Department of Civil Engineering, Technical university of Denmark.









- Standaert P. 1984. Thermal evaluation of window frames by the finite difference method. In: *Proceedings of windows in building design and maintenance*. Stockholm: Swedish Council for Building Research.
- Svendsen, S, Kragh, J., and Laustsen, J.B. 2005. Energy performance of windows based on net energy gain, *Proceedings of the 7th Nordic symposium on building physics*.
- Svendsen, S., K. Duer, and P. Noyé. 2000. *Calculating the heat transfer coefficient of frame profiles in aluminium*. Report SR-0023 – Revision 1. Lyngby: Department of Buildings and Energy, Technical University of Denmark.
- Yin, S.H., T.Y. Wung, and K. Chen. 1978. Natural convection in an air layer enclosed within rectangular cavities, *International Journal of Heat and Mass Transfer*, Vol. 21, pp. 307-315.
- Wright, J.L. and Sullivan, H.F. 1994. A two-dimensional numerical model for natural convection in a vertical, rectangular window cavity, *ASHRAE Transactions*, Vol. 100, pp. 1193-1206.
- Wright, J. 1996. A correlation to quantify convective heat transfer between vertical window glazings. *ASHRAE Transactions*, Vol. 102, pp. 940-946.
- Zhao, Y., D. Curcija, and W.P. Goss. 1997. Prediction of the multicellular flow regime of natural convection in fenestration glazing cavities. *ASHRAE Transactions*, Vol. 103.
- Zhao, Y. 1998. *Investigation of heat transfer performance in fenestration system based on finite element method*. Ph.D. dissertation. Massachusetts: Department of Mechanical and Industrial Engineering, University of Massachusetts Amherst.
- Wikipedia. 2007. Wikipedia, the free encyclopedia, <http://en.wikipedia.org/>. (Valid 2007-07-04)











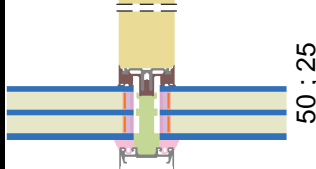

Appendix - List of Highly Thermal Insulating Window Frames



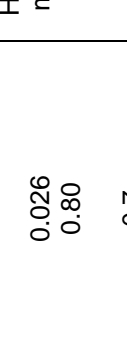

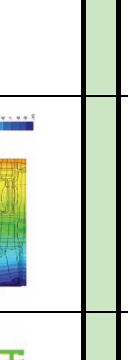
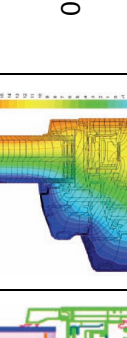




Table A-1 gives several examples of window frames fulfilling the PassivHaus requirement, where the U_F -value for the frame has to be so low that the window as a whole has a window $U_w \leq 0.80 \text{ W/(m}^2\text{K)}$. U_F is calculated according to the procedures in ISO 10077-2, with an insulation panel instead of the actual glazing. In this table a reference is mainly made to the German PassivHaus www.passiv.de website as many of these frames are redirected from elsewhere to the German PassivHaus website with easy access to most of the characteristic properties/information in form of data sheets and certificates. As an example most of the windows located at the UK PassivHaus website (<http://www.passivhaus.org.uk/index.jsp?id=737>) are certified by the German PassivHaus Institute and many of them are directly referring to German websites and e-mail addresses. One will also find that many of the companies have offices/addresses in both Germany and UK or elsewhere. Table includes almost only window frames where the frame U_F -value is found, with a few exceptions.












Table A-1. Examples of window frames fulfilling the PassivHaus requirement, where the U_F -value for the frame has to be so low that the window as a whole has a window $U_w \leq 0.80 \text{ W/(m}^2\text{K)}$. Manufacturer, product name, various illustrations, material selection and various properties like U -values (window as a whole, glass pane and frame) are given. Reference is mainly made to www.passiv.de as many of these frames are redirected from elsewhere to the German PassivHaus website with easy access to most of the characteristic properties/information in data sheets and certificates.


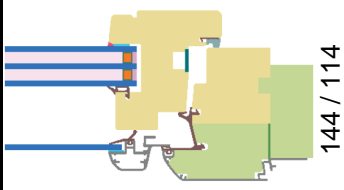




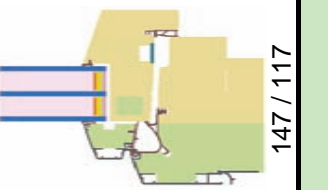

Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_F ($\text{W/(m}^2\text{K)}$)	sp1, sp2, sp3 Ψ_{g1} , Ψ_{g2} , Ψ_{g3} ($\text{W/(m}^2\text{K)}$) U_{w1} , U_{w2} , U_{w3} ($\text{W/(m}^2\text{K)}$) U_{g1} $w \times h$	Materials	Ref
REHAU AG + Co, Hochbau Ytterbium 4, D-91058 Erlangen Tel. 09131 / 92-50 Fax. 09131 / 771430 erlangen.vk.hb@rehau.c om www.rehau.de	REHAU Clima Design		 120 x 120		0.71	Swisspacer CHROMA:TECH V CHROMA:TECH + Niro 0.035 / 0.036 / 0.037 0.79 / 0.79 / 0.80 0.7 1.23 x 1.48	PVC-Profile, Kammern mit PU ausgeschäumt, wärmegeämmte Vorsatzschale, Stahlprofil im Flügelrahmen als Aussteifung warmseitig angeordnet	www.pasiv.de
	Fassadensystem REHAU- Polytec 50 PHZ		 54 ; 27		0.76 / 0.75	Swisspacer V 0.036 / 0.035 0.80 0.7 1.23 x 1.48	Stahlverstärktes PVC- Pfosten- bzw. Riegelprofil; außenliegendes Aluminium-Abdeckprofil; Dämmung aus PE- Schaumprofil zwischen den Scheiben	www.pasiv.de











Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	sp1, sp2, sp3 $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
Bruckner Fenster und Türen GmbH Oberrosenauerwald 15, A-3920 Groß Gerungs Tel. 0043 (0) 2812 / 84 02 Fax. 0043 (0) 2812 / 84 02 18 office@bruckner.co.at www.bruckner.co.at	Bruckner- Variotherm		 148 x 148		0.74	Thermix 0.035 0.80 0.7 1.23 x 1.48	Holz mit gedämmter Vorsatzschale aus ABS- Kunststoff und Aluminiumverblendung	www.pas-siv.de
H. Buck GmbH, Fenster und Türen Industriestr. 4, D-27432 Bremervörde Tel. 04761 / 9772-0 Fax. 04761 / 6467 info@fenster-buck.de www.fenster-buck.de	VÖRDE- Passivhaus fenster	 	 125 x 120 (132x127)  		0.72	Thermix 0.034 0.79 0.7 1.23 x 1.48	Holz/Purenit/PU/Purenit/ Holz	www.pas-siv.de









Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{s1}, \Psi_{s2}, \Psi_{s3}$ Ψ_{g2}, Ψ_{g3} (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
EGE Holzbau GmbH & Co. KG Grabenweg 20, D-06526 Sangerhausen Tel. 03464/6711-0 Fax. 03464/6711-19 joerg.brauer@ege.de www.ege.de	EGE- THERM PLUS				0.77	Swisspacer V 0.033 0.80 0.7 1.23 x 1.48	Blendrahmen aus Holz/PU-Verbundmaterial; Flügelrahmen aus Holz/PU/PU-Recyclat-Verbundmaterial; jeweils mit aufgeklippten Aluminium-Dämmschalen	www.pas-siv.de
VEKA AG Dieselstr. 8 D-48324 Sendenhorst Telefon: 02526 29-0 Fax: 02526 29-3710 E-Mail: info@veka.com Internet: www.veka.de	TOPLINE plus					0.8 (U_w)		www.veka.de
Endl-Wagner GmbH Hötzlarn 17, A-4770 Andorf Tel. 0043 (0) 7766 / 41117 Fax. 0043 (0) 7766 / 41117-50 office@endl.at www.endl.at	ON TOP PLUS				0.65	Swisspacer V 0.033 0.79 0.7 1.23 x 1.48	Holz-Aluminium-Bauweise Dämmstoffprofil zwischen den Scheiben, großvolumige Innendichtung	www.pas-siv.de
esco Metallbausysteme GmbH Dieselstr. 2, D-71254 Ditzingen Tel. 07156 / 3008-0 Fax. 07156 / 8079 info@esco-online.de www.esco-online.de	FWT 50-1 HA E-plus				0.73	Swisspacer V 0.034 0.80 0.7 1.23 x 1.48	Holz-Aluminium-Bauweise, Außendichtung aus aufgeschäumtem EPDM, Dämmstoffprofil zwischen den Scheiben, großvolumige Innendichtung zur thermischen Trennung	www.pas-siv.de







Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
Hubert Fosoderer A-4902 Wolfsegg Tel. 0043 (0) 7676 / 5006 Vertrieb: G.S. Georg Stemeseder GmbH, A- 5322 Hof bei Salzburg hoertenhuber@fosodede www.fosoderer.com	Alto Nova / Variotherm Holz- Aluminium- Fenster				0.76	Thermix 0.035 0.80 0.7 1.23 x 1.48	Holz mit gedämmter Vorsatzschale aus ABS- Kunststoff und Aluminiumverblendung. Dämm-Material: Papierflocken WLG 040	www.pas-siv.de
GEALAN WERK Fickenscher GmbH Hofer Straße 80, D- 95145 Oberkotzau Tel. 09286 / 774-210 Fax 09286 / 774-141 info@gealan.de www.gealan.de	GEALAN S 7000 IQ Passivhaus				0.82	Swisspacer V 0.026 0.80 0.7 1.23 x 1.48	PVC-Profilen mit Dämmschalen aus Alu/PU- Hartschaum/PEVerbund material (gleiches Profil im Brüstungs- und Laibungsbereich); thermisch getrennte Stahlverstärkungsprofile im Blend- und Flügelrahmen	www.pas-siv.de
Hermann Gutmann Werke AG Nürnberg Straße 57- 81, D-91781 Weißenburg Tel. 091 41 / 992-0 gutmann@gutmann.de www.gutmann.de	MIRA- THERM- PH 68 PS	 			0.75	Thermix 0.033 0.80 0.7 1.23 x 1.48	Rahmenprofile aus Verbundmaterial (Blendrahmen: Holz; gedämmt mit PU- Schaum, Flügelrahmen: Holz; gedämmt mit PU- Schaum und PU- Recyclat) mit Dämmschalen aus Alu/PS- Schaum/Kunststoff- Verbundmaterial (gleiches Profil im Brüstungs- und Laibungsbereich)	www.pas-siv.de





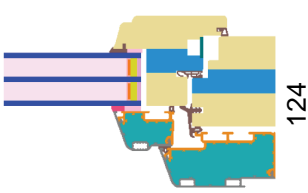







Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{01}, \Psi_{02}, \Psi_{03}$ ($W/(mK)$) U_{w1}, U_{w2}, U_{w3} ($W/(m^2K)$) U_g $w \times h$	Materials	Ref
HEUSER Türen + Fenster-Metalbau GmbH Burgweg 6, D-56357 Michlen Tel. 067 72 / 9315-10 Tel. 067 72 / 9315-70 www.heuser-tueren-fenster.de	Super-Warmfenster U 07 Serie HF 8120				0.65 (0.72) ?	Thermix 0.030 (0.040) ? 0.75 (0.80) ? 0.7 1.23 x 1.48	Holz-Aluminium-Fensterrahmen mit Dämmung aus Polyurethan-Schaum	www.pas-siv.de
Passivhaus-Holzfensterring e.V. Postfach 1332, D-94203 Regen Tel. 09921 / 9442-62 info@passivhausring.de www.passivhausring.de	Öko-Therm				0.71 / 0.74	Swisspacer with Al foil 0.038 0.80 0.7 1.23 x 1.48	Holz/Purenit/PU/Purenit/Holz	www.pas-siv.de
Internorm International GmbH Ganggutstr. 131, A-4050 Traun Tel. 0043 (0) 7229 / 770-3188 Fax. 0043 (0) 72 29 / 71293 www.internorm.com	edijtjion passiv				0.73	Thermix 0.038 0.80 0.7 1.23 x 1.48	Holz-Rahmen mit PU-Dämmschicht in der Aluminium-Vorsatzschale, zusätzliche Dämmeinlage aus PU-Schaum	www.pas-siv.de
	edijtjion passiv, Fixverglasung				0.63	Thermix 0.043 0.79 0.7 1.23 x 1.48	Aluminium/PU/Holz-Verbundkonstruktion	www.pas-siv.de











Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{s1}, \Psi_{s2}, \Psi_{s3}$ $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
	ed j tion 4 passiv, Verbundfen- sterrahmen				0.90 / 0.98	Refined steel 0.039 0.80 0.66 (0.58 total) 1.23 x 1.48	Blendrahmen aus Holz- Dämmstoff-Aluminium- Verbundmaterial; Flügelrahmen zur Aufnahme der Verbundverglasung in Holz-Aluminium- Bauweise	www.pas-siv.de
	ed j tion 4 passiv / vetro- design				0.89 / 0.97	Refined steel 0.043 0.80 0.66 (0.58 total) 1.23 x 1.48	Blendrahmen aus Holz- Dämmstoff-Aluminium- Verbundmaterial; Flügelrahmen zur Aufnahme der Verbundverglasung in Holz-Aluminium- Bauweise	www.pas-siv.de
Josko Fenster und Türen GmbH Rosdorf 26, A-4794 Kopfling Tel. 07763 / 2241-416 Fax. 07763 / 2810-416 office@josko.at www.josko.at	PassivEco 120				0.73 / 0.75	Thermix TX.N 0.035 0.80 0.7 1.23 x 1.48	Gedämmter Holz- Aluminium-Rahmen; Dämmung aus XPS ($\lambda =$ 0,035 W/(mK))	www.pas-siv.de





Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{s1}, \Psi_{s2}, \Psi_{s3}$ $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
Holzbau Kasträter GmbH Isoldenstr. 30, D-45892 Gelsenkirchen-Buer Tel. 0209 / 99919-0 Fax. 0209 / 99919-99 info@kaustraeter.de www.kaustraeter.de	Kasträter ThermoWo od				0.73 / 0.78	Swisspacer / Refined steel 0.028 / 0.030 0.79 / 0.80 0.7 1.23 x 1.48	Holzrahmen mit Dämmung aus Kork	www.pas-siv.de
Koch Fenster- u. Türenbau GmbH Graf-Zeppelin-Strasse 23, D-57610 Altenkirchen Tel. 02681 / 9551-0 Fax. 02681 / 9551-22	Koch 104'er passiv				0.70 / 0.73 / (w/rain screen) 0.71 (w.o/rain screen)	Thermix / TGI 0.037 / 0.038 (Thermix) 0.040 / 0.042 (TGI) 0.79 Thermix / 0.80 TGI 0.7 1.23 x 1.48	Gedämmter Holz- Fensterrahmen; Dämmung aus Kork (grey) bzw. aus PU- Recyclingwerkstoff (green)	www.pas-siv.de
	Parcus- Fenster				0.72	Thermix / TPS 0.033 Therm. / 0.036 TPS 0.79 0.7 1.23 x 1.48	Holz/Purenit/PU/Purenit/ Holz	www.pas-siv.de
Kochs GmbH Am Boscheier Berg 5, D- 52134 Herzogenrath info@kochs.de www.kochs.de	eCO ₂				0.74	Thermix / TGI-wave 0.030 0.79 0.7 1.23 x 1.48	PVC profile with PUR (λ = 0.030 W/(mK))	www.pas-siv.de











Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	Ψ_{s1} , Ψ_{s2} , Ψ_{s3} Ψ_{g1} , Ψ_{g2} , Ψ_{g3} (W/(mK)) U_{w1} , U_{w2} , U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
KPA Fensterbau GmbH Teichweg 6, A-7571 Rudersdorf Tel. 0043-33 82 / 735-33 Fax. 0043-33 82 / 735-32	Wellness AKTIV / VIVA.MAX		 127	 127	0.80 / 0.77	Thermix 0.032 0.80 0.7 1.23 x 1.48	Blendrahmen aus Holz/PU-Hartschaum/PU-Recyclat-Verbundmaterial; Flügelrahmen aus Holz/PU-Recyclat-Verbundmaterial; jeweils mit Aluminium-Vorsatzschale	www.pas siv.de
Lederbauer Fenster u. Türen GmbH & Co. KG Eberschwang 81, A-4906 Eberschwang Tel. 0043 (0) 7753 / 2511-0 office@lederbauer.at	Lederbauer ÖKOplus Alu (Kork)		 139	 139	0.75	Thermix / Swisspacer / Swisspacer V 0.030 / 0.036 / 0.023 0.80 0.7 1.23 x 1.48	Rahmenmaterial: Holz-Aluminium-Rahmen mit Polystyrol- oder Kork Dämmung	www.pas siv.de
Lederbauer ÖKOplus Alu (Styrodur)			 139	 139	0.73	Thermix / Swiss V / Swisspacer + Niro / TGI 0.025 / 0.019 / 0.033 / 0.035 0.80 0.7 1.23 x 1.48	Rahmenmaterial: Holz-Aluminium-Rahmen mit Polystyrol- oder Kork Dämmung	www.pas siv.de
ECO plus PH			 128 / 122	 128 / 122	0.90 / 0.88	Swisspacer V 0.030 / 0.030 0.003 / 0.011 0.84 / 0.85 (not inbuilt / inbuilt) 0.7 1.23 x 1.48	Rahmen aus Holz mit Dämmstoffeinlagen aus PU-Schaum, Entwässerung über Aluprofil	www.pas siv.de




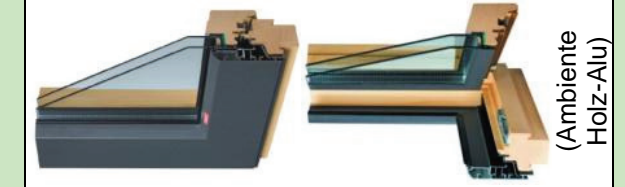
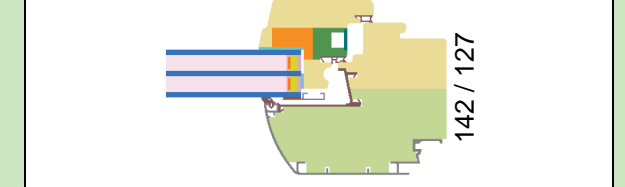
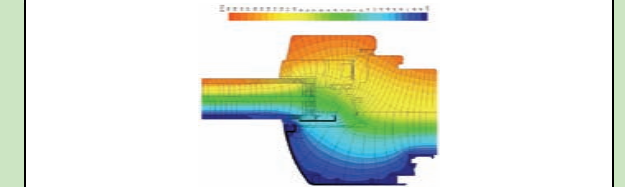
Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ ($W/(mK)$) U_{w1}, U_{w2}, U_{w3} ($W/(m^2K)$) U_g $w \times h$	Materials	Ref
	Lederbauer ÖKOplus Alu (Styrodur) SwissV		139		0.73	Swisspacer V 0.019 0.75 0.7 1.23 x 1.48		www.pas siv.de
Pural Profilwerk GmbH & Co. KG Ziegeleistr. 11, D-64560 Riedstadt Tel. 06158 / 9260-5 Fax. 06158 / 9260-70 info@pural-profile.de www.pural-profile.de	RP-ISO- PURAL BP		 125		0.71	Thermix 0.038 0.80 0.7 1.23 x 1.48	Rahmenmaterial: Hochfester PU Dämmkern zur thermischen Trennung der äußeren und inneren Aluminium-Deckschale	www.pas siv.de
Tischlerei Mur Alte Landstraße 67, A- 6123 Vomperebach Tel. 05242 / 71206 Fax. 05242 / 71206-4 office@tmur.at www.tmur.at	WM- Passivhaus fenster		 131		0.73 / 0.80	Swisspacer V 0.024 0.77 0.7 1.23 x 1.48	Holz/Purenit/PU/Purenit/ Holz	www.pas siv.de
Ing.-Büro A. Naumann & H. Stahr Sommerfelderstr. 11, D- 04299 Leipzig Tel. 0341 / 86319-70 Fax. 0341 / 86319-99	Passivhaus Kastenfen- ster		 163 / 160		0.62 / 0.71	2 x Thermix 0.022 0.68 0.62 1.23 x 1.48	Rahmenmaterial: Holz	www.pas siv.de


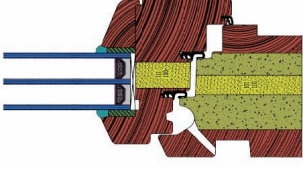



Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$sp1, sp2, sp3$ $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ ($W/(mK)$) U_{w1}, U_{w2}, U_{w3} ($W/(m^2K)$) U_g $w \times h$	Materials	Ref
Nestle Fenster Grünmetzsteiner Straße 6, D-72178 Waldachtal- Turlingen Tel. 07443 / 96 48-0 Fax. 07443 / 96 48-10 info@nestlefenster.de www.nestlefenster.de	Novum K1- P				1.10 / 1.14	Thermix 0.031 0.79 0.60 (0.53 total) 1.23 x 1.48	Fensterahmen aus Holzprofilen mit Aluminiumvorsatzschale	www.pas-siv.de
NIVEAU Fenster Westerburg GmbH Langenhahner Straße, D-56457 Westerburg Tel. 026 63 / 29 01-0 Fax. 026 63 / 22 33 kontakt@niveau.de www.niveau.de	KombiRoya I Plus PH				0.68	Thermix 0.040 0.79 0.7 1.23 x 1.48	Rahmenprofile aus Holz/PU/Holz- Verbundmaterial; Dämmschalen aus Aluminium /Polystyrol- Schaum/Polyamid- Verbundmaterial	www.pas-siv.de
OPTIWIN GmbH Wildbichlerstr. 1, A-6341 Ebbs Tel. 0043 (0) 5373 / 46046-12 Fax. 0043 (0) 5373 / 46046-40 www.optiwin.net office@optiwin.info	Drei3Holz				0.73	Swisspacer with Al foil 0.035 0.79 0.7 1.23 x 1.48	Rahmenmaterial: Holz und Holzwerkstoffe, Flügelrahmendämmung aus Balsa bzw. Kork, abnehmbare Vorsatzschale aus Lärchenholz	www.pas-siv.de
Solarfassa de					0.69	Swisspacer with Al foil 0.036 0.79 0.7 1.23 x 1.48	Fassade aus Holz und Holzwerkstoffen und Kork	www.pas-siv.de

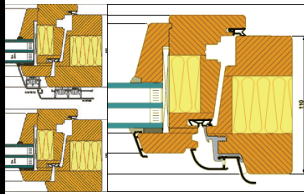


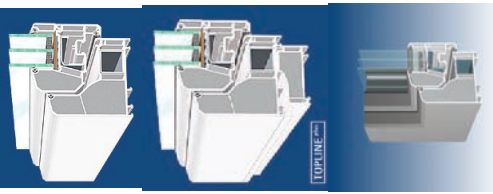


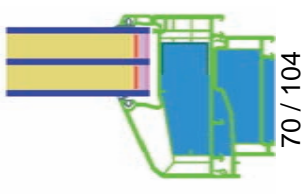

Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{s1}, \Psi_{s2}, \Psi_{s3}$ $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
Profine GmbH Kömmerring Kunststoffe Postfach 2165, D-66929 Pirmasens Tel. 06331 / 562298 Fax. 06331 / 562127	eCO ₂				0.74	Thermix / TGI-wave 0.030 0.79 0.7 1.23 x 1.48	PVC profile with PUR (λ = 0.030 W/(mK))	www.pas siv.de
	ThermoWin				0.75 / 0.80	Thermix 0.030 0.79 0.7 1.23 x 1.48	Rahmenmaterial: PVC- Profile, Kammern mit PU ausgeschäumt, Stahlprofil als Aussteifung warmseitig angeordnet	www.pas siv.de
RAICO Bautechnik GmbH Gewerbegebiet Nord 2, D-87772 Pfaffenhausen Tel. 08265 / 911-0 Fax. 08265 / 911-100 info@raico.de www.raico.de	RAICO THERM+ 50H-I Isobloc P				0.75	Swisspacer V 0.034 0.80 0.7 1.23 x 1.48	Holz-Aluminium- Bauweise	www.pas siv.de
	RAICO THERM+ 56H-I Isobloc P				0.73	Swisspacer V 0.034 0.80 0.7 1.23 x 1.48	Holz-Aluminium- Bauweise	www.pas siv.de










Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
	RAICO THERM+ 76H-I Isobloc P		 76		0.69	Thermix 0.038 0.80 0.7 1.23 x 1.48	Holz-Aluminium- Bauweise	www.pas siv.de
Salamander Industrie- Produkte GmbH Jakob-Sigle-Str. 58, D- 86842 Türkheim Tel. 08245 / 52-0 Fax. 08245 / 52-300 info@sip.de www.sip.de	Salamande r THERMOLI NE®		 139		0.81	Swisspacer V 0.024 0.80 0.7 1.23 x 1.48	Rahmen aus PVC- Profilen mit Dämmschalen aus Aluminium/Polystyrol- Schaum/Polyamid- Verbundmaterial (gleiches Profil im Brüstungs- und Laibungsbereich) thermisch getrennte Stahverstärkungsprofile im Blend- und Flügelrahmen	www.pas siv.de




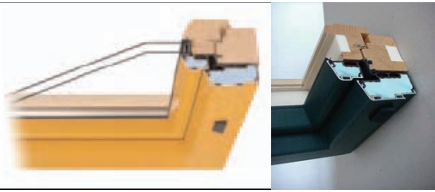

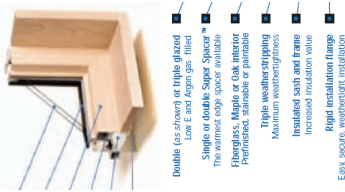
Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ ($W/(mK)$) U_{w1}, U_{w2}, U_{w3} ($W/(m^2K)$) U_g $w \times h$	Materials	Ref
<p>Schüco International Karolinenstraße 1-15, D-33609 Bielefeld Tel. 03443 / 342-177 Fax. 0521 / 783-854 wgeismann@schueco.de  www.schueco.de</p>	<p>Corona SI 82 + Passiv</p>		 <p>121</p>		<p>0.75</p>	<p>Thermix 0.034 0.80 0.7 1.23 x 1.48</p>	<p>Rahmen aus PVC-Profilen; Kammern zum Teil mit Vakuumpaneelen gefüllt; Aluminium-Verstärkungen (gelbe Stege) senkrecht zur Wärmestromrichtung angeordnet, Verglasung 44 mm (4/16/4/16/4) Falzdichtung als raumseitige Flügelüberschlagsdichtung, großvolumige Mitteldichtung im Blendrahmen, Entwässerung über ausgeformte Rinne und Hohlkammern mit Bohrungen</p>	<p>www.pas-siv.de</p>
<p>Bau- und Möbeltischlerei Schwager Wulferdingener Str. 66, D-32549 Bad Oeynhausen Tel. 05734 / 1386 Fax. 05734 / 4694</p>	<p>Schwager Passivstar 2000</p>		 <p>119</p>		<p>0.78</p>	<p>Thermix 0.029 0.80 0.7 1.23 x 1.48</p>	<p>Rahmen in Holz-/Purenit-/PU-Sandwichbauweise</p>	<p>www.pas-siv.de</p>
<p>Tischlerei Hermann Seelos Hintere Gasse 1, A-6175 Kematen / Tirol Tel. 0043 (0) 5232-2284</p>	<p>VariTherm K</p>		 <p>142</p>		<p>0.71</p>	<p>Thermix 0.036 0.79 0.7 1.23 x 1.48</p>	<p>Blend- und Flügelrahmen aus Verbundmaterial aus Holz/PU-Hartschaum/PURecycling material; jeweils mit Aluminium-Vorsatzschale</p>	<p>www.pas-siv.de</p>




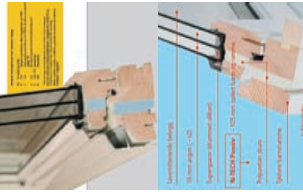


Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f (W/(m ² K))	sp1, sp2, sp3 $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
Franz Silber Fensterbau GmbH A-4613 Mistelbach 30 Tel. 0043 (0) 7243 / 57170-0 Fax. 0043 (0) 7243 / 57170-3 office@silberfenster.at www.silberfenster.at	silber-Passiv				0.74 / 0.79	Swisspacer V with refined steel foil 0.033 0.80 0.7 1.23 x 1.48	Holzrahmen mit Purenit-Dämmeinlage als Verbundmaterial, PU-Schaum als Dämmschicht zwischen Aluminium Vorsatzschale und Rahmen	www.pas-siv.de
STABIL Bauelemente GmbH Landscha an der Mur 70, A-8424 Gabersdorf Tel. 0043 (0) 676 / 8718-3419 Fax. 0043 (0) 3452 / 9003-3015 office@stabil.at www.stabil.at	Ambiente Holz-Alu Passiv (Ambiente Holz-Alu)				0.73 / 0.72	Thermix 0.036 0.80 0.7 1.23 x 1.48	Blendrahmen aus Holz/XPS (l = 0,035)/Aluminium-Verbundmaterial Flügelrahmen aus Holz; gedämmt mit PU-Hartschaum (l = 0,040) und PU-Recycling-Material (l = 0,075 W/(mK))	www.pas-siv.de

Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f (W/(m ² K))	sp1, sp2, sp3 $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
<p>Fenster Striegel GmbH Straubweg 3, D-88348 Saulgau-Bierstetten Tel. 07583 / 9415-0 Fax. 07583 / 9415-40 fenster.striegel@t-online.de www.fenster-striegel.de</p>	<p>Ultrapur S Holz/Holz- Alu</p>				<p>0.72 / 0.78</p>	<p>Thermix 0.025 0.77 0.7 1.23 x 1.48</p>	<p>Holzrahmen mit PU-Kern, zusätzliche Purenit- Schichten im unteren Blendrahmen, auch mit Alu-Vorsatzschale erhältlich.</p>	<p>www.pas-siv.de</p>
<p>Stukenborg Tischlerei GmbH Alte Carumer Str. 26, D- 49393 Lohne Tel. 04442 / 73 910 info@stukenborg.info www.stukenborg.info</p>	<p>Stukenborg Passivhaus fenster</p>				<p>0.72</p>	<p>Thermix 0.038 0.80 0.7 1.23 x 1.48</p>	<p>Rahmenmaterial: Holz mit gedämmter Vorsatzschale aus PU- Schaum und Purenit und Aluminium- Vorsatzschale.</p>	<p>www.pas-siv.de</p>

Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	$\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
VARIOTEC GmbH & Co. KG Weißmarterstr. 3, D-92318 Neumarkt/Oberpfalz Tel. 09181 / 6946-0 Fax. 09181 / 8825 info@variotec.de www.variotec.de	Energyframe				0.73 (0.76)	Thermix 0.031 (0.033) 0.80 0.7 1.23 x 1.48	Rahmenmaterial: Holz/PU-Sandwichaufbau	www.pas-siv.de
VEKA AG Dieselstraße 8, D-48324 Sendenhorst Tel. 02526 / 29-0 Fax. 02526 / 29-3710 www.veka.com	VEKA TOPLINE Plus				0.74	Refined steel 0.035 0.80 0.7 1.23 x 1.48	Rahmenmaterial: PVC- Profile, Kammern mit PU ausgeschäumt, Stahlprofile als Aussteifung warmseitig angeordnet.	www.pas-siv.de
	VEKA TOPLINE Plus, Festverglasung				0.72 / 0.77	Swisspacer V 0.032 0.79 0.7 1.23 x 1.48	Rahmenmaterial: PVC- Profil mit ausgeschäumten Hohlkammern. Dämmung: Polyurethan Hartschaum WLG 035	www.pas-siv.de

Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	sp1, sp2, sp3 $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
WERU AG Zumhofer Str. 25, D-73635 Rudersberg Tel. 07183 / 303773	WERU- Passivhaus fenster		 130		0.75 / 0.80	Thermix 0.030 0.79 0.7 1.23 x 1.48	Rahmenmaterial: PVC-Profile, Kammern mit PU ausgeschäumt, Stahlprofil als Aussteifung als Aussteifung warmseitig angeordnet.	www.passivhaus.de
Wiegand Fensterbau Feldstr. 10, D-35116 Hatzfeld-Holzhausen Tel. 06452 / 9336-0 Fax. 06452 / 933633 dw-plus@wiegand-info.de www.passiv-fenster.de	Wiegand DW-Plus		 137		0.80	Thermix 0.024 0.79 0.7 1.23 x 1.48	Rahmen in Holz-/PU-Sandwichbauweise mit Alu-Vorsatzschale	www.passivhaus.de
Firma Winter Holzbau GmbH Bahnhofstr. 54, D-27321 Thedinghausen Tel. 04204 / 997-0 winter@winter-holzfenster.de www.ewitherm.de	Passivhaus Fenstersyst em ewitherm		 154 / 169		0.74 / 0.82	Thermix 0.032 0.80 0.7 1.23 x 1.48	Holz/Kork/Holz als Sandwichkonstruktion	www.passivhaus.de

Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f ($W/(m^2K)$)	sp1, sp2, sp3 $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ ($W/(mK)$) U_{w1}, U_{w2}, U_{w3} ($W/(m^2K)$) U_g w x h	Materials	Ref
Zwönitzer Bauelemente GmbH Hauptstraße 6, D-08297 Zwönitz / OT Brünlos Tel. 037 296 / 408-0 Fax. 037 296 / 408-33 holler@holler-fenster.de www.holler-fenster.de	HOLZ ^{plus} PASSIV 100		 141		0.80 / 0.85	Swisspacer V 0.026 0.80 0.7 1.23 x 1.48	Rahmenprofile aus Holz mit Dämmeinlagen aus PU-Schaum ($\lambda = 0,030$ W/mK) Thermisch getrennte Regenschiene	www.pas-siv.de
	PASSIVHA US- FENSTER HOLZ-ALU MIRA- Therm PH 68 PS		 129		0.75	Thermix 0.033 0.80 0.7 1.23 x 1.48	<ul style="list-style-type: none"> • zum Konstruktionsaufbau • Holzkonstruktion • Aluminium-Verbund-Rahmen Profilsystem MIRA-THERM PH68 von GUTMANN mit einer wärmegeprägten Aluminiumschale	www.pas-siv.de
Thermotech Windows Ltd. Telephone: 1-888-930-9445 Facsimile: 613-839-9066 www.thermotechfiberqla.com ss.com		 <ul style="list-style-type: none"> Double (as shown) or triple glazed Low E and Argon gas filled Single or Double Super Spacer™ The warmest edge spacer available Thermally broken or non-thermally broken Polycarbonate, fiberglass or aluminum Triple weatherstripping Maximum weathertightness Included sash and frame Increased insulation value Right-hand/left-hand design Easy secure, no-drill, no-screw installation 					Found at website: “Thermotech is not a normal window company.” “For Thermotech, Energy Star’s criteria are the starting point. Most of our windows insulate 50% better and allow twice the passive solar gain of typical Energy Star windows.”	www.pas-sivhaus.org.uk/

Manufacturer / Product	Name	Illustration 1	Illustration 2 (mm x mm)	Illustration 3	U-value U_f (W/(m ² K))	sp1, sp2, sp3 $\Psi_{g1}, \Psi_{g2}, \Psi_{g3}$ (W/(mK)) U_{w1}, U_{w2}, U_{w3} (W/(m ² K)) U_g w x h	Materials	Ref
Sigg GesmbH & CoKG, Tischlerei - Glaserei Allgauerstraße 155, A-6912 Hörbranz T +43/5573/82255-0, F +43/5573/82255-4 fischlerei@sigg.at , www.sigg.at	PassivHaus Fenster				0.93 (pine) 1.0 (larch)	0.035 (Ψ) 0.56 (U_g) (4/18/4/18/4 with Ar)	Wood with cavities	http://www.passivhausfenster.at/km/s/media/uploads/_fz_folde_r_deutsch_copy1.pdf
NorDan AS Postboks 83/84, 4465 Moi Norway. Phone 47 51 40 40 00. Fax 47 51 40 17 72 www.nordan.no	N-Tech Passiv Superspacer					0.7 (U_w) 0.65 (0.66) (4/16/4/16/4 with Ar)	Wood with PUR	www.nordan.no

The SINTEF Group is the largest independent research organization in Scandinavia. Our vision is "Technology for a better society". Our goal is to contribute to wealth creation and to the sound and sustainable development of society. We generate new knowledge and solutions for our customers, based on research and development in technology, the natural sciences, medicine and the social sciences.

SINTEF Building and Infrastructure is the third largest building research institute in Europe. Our objective is to promote environmentally friendly, cost-effective products and solutions within the built environment.

SINTEF Building and Infrastructure is Norway's leading provider of research-based knowledge to the construction sector. Through our activity in research and development, we have established a unique platform for disseminating knowledge throughout a large part of the construction industry.

